




## Legend

-  PRRD boundary
-  Watershed boundary
-  Main Streams






## Mapped aquifers

### Aquifer type


-  Bedrock
-  Overburden

## GW Provincial drinking water (BCMoE)




### % of samples exceeding guideline

-  No exceedance
-  <= 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

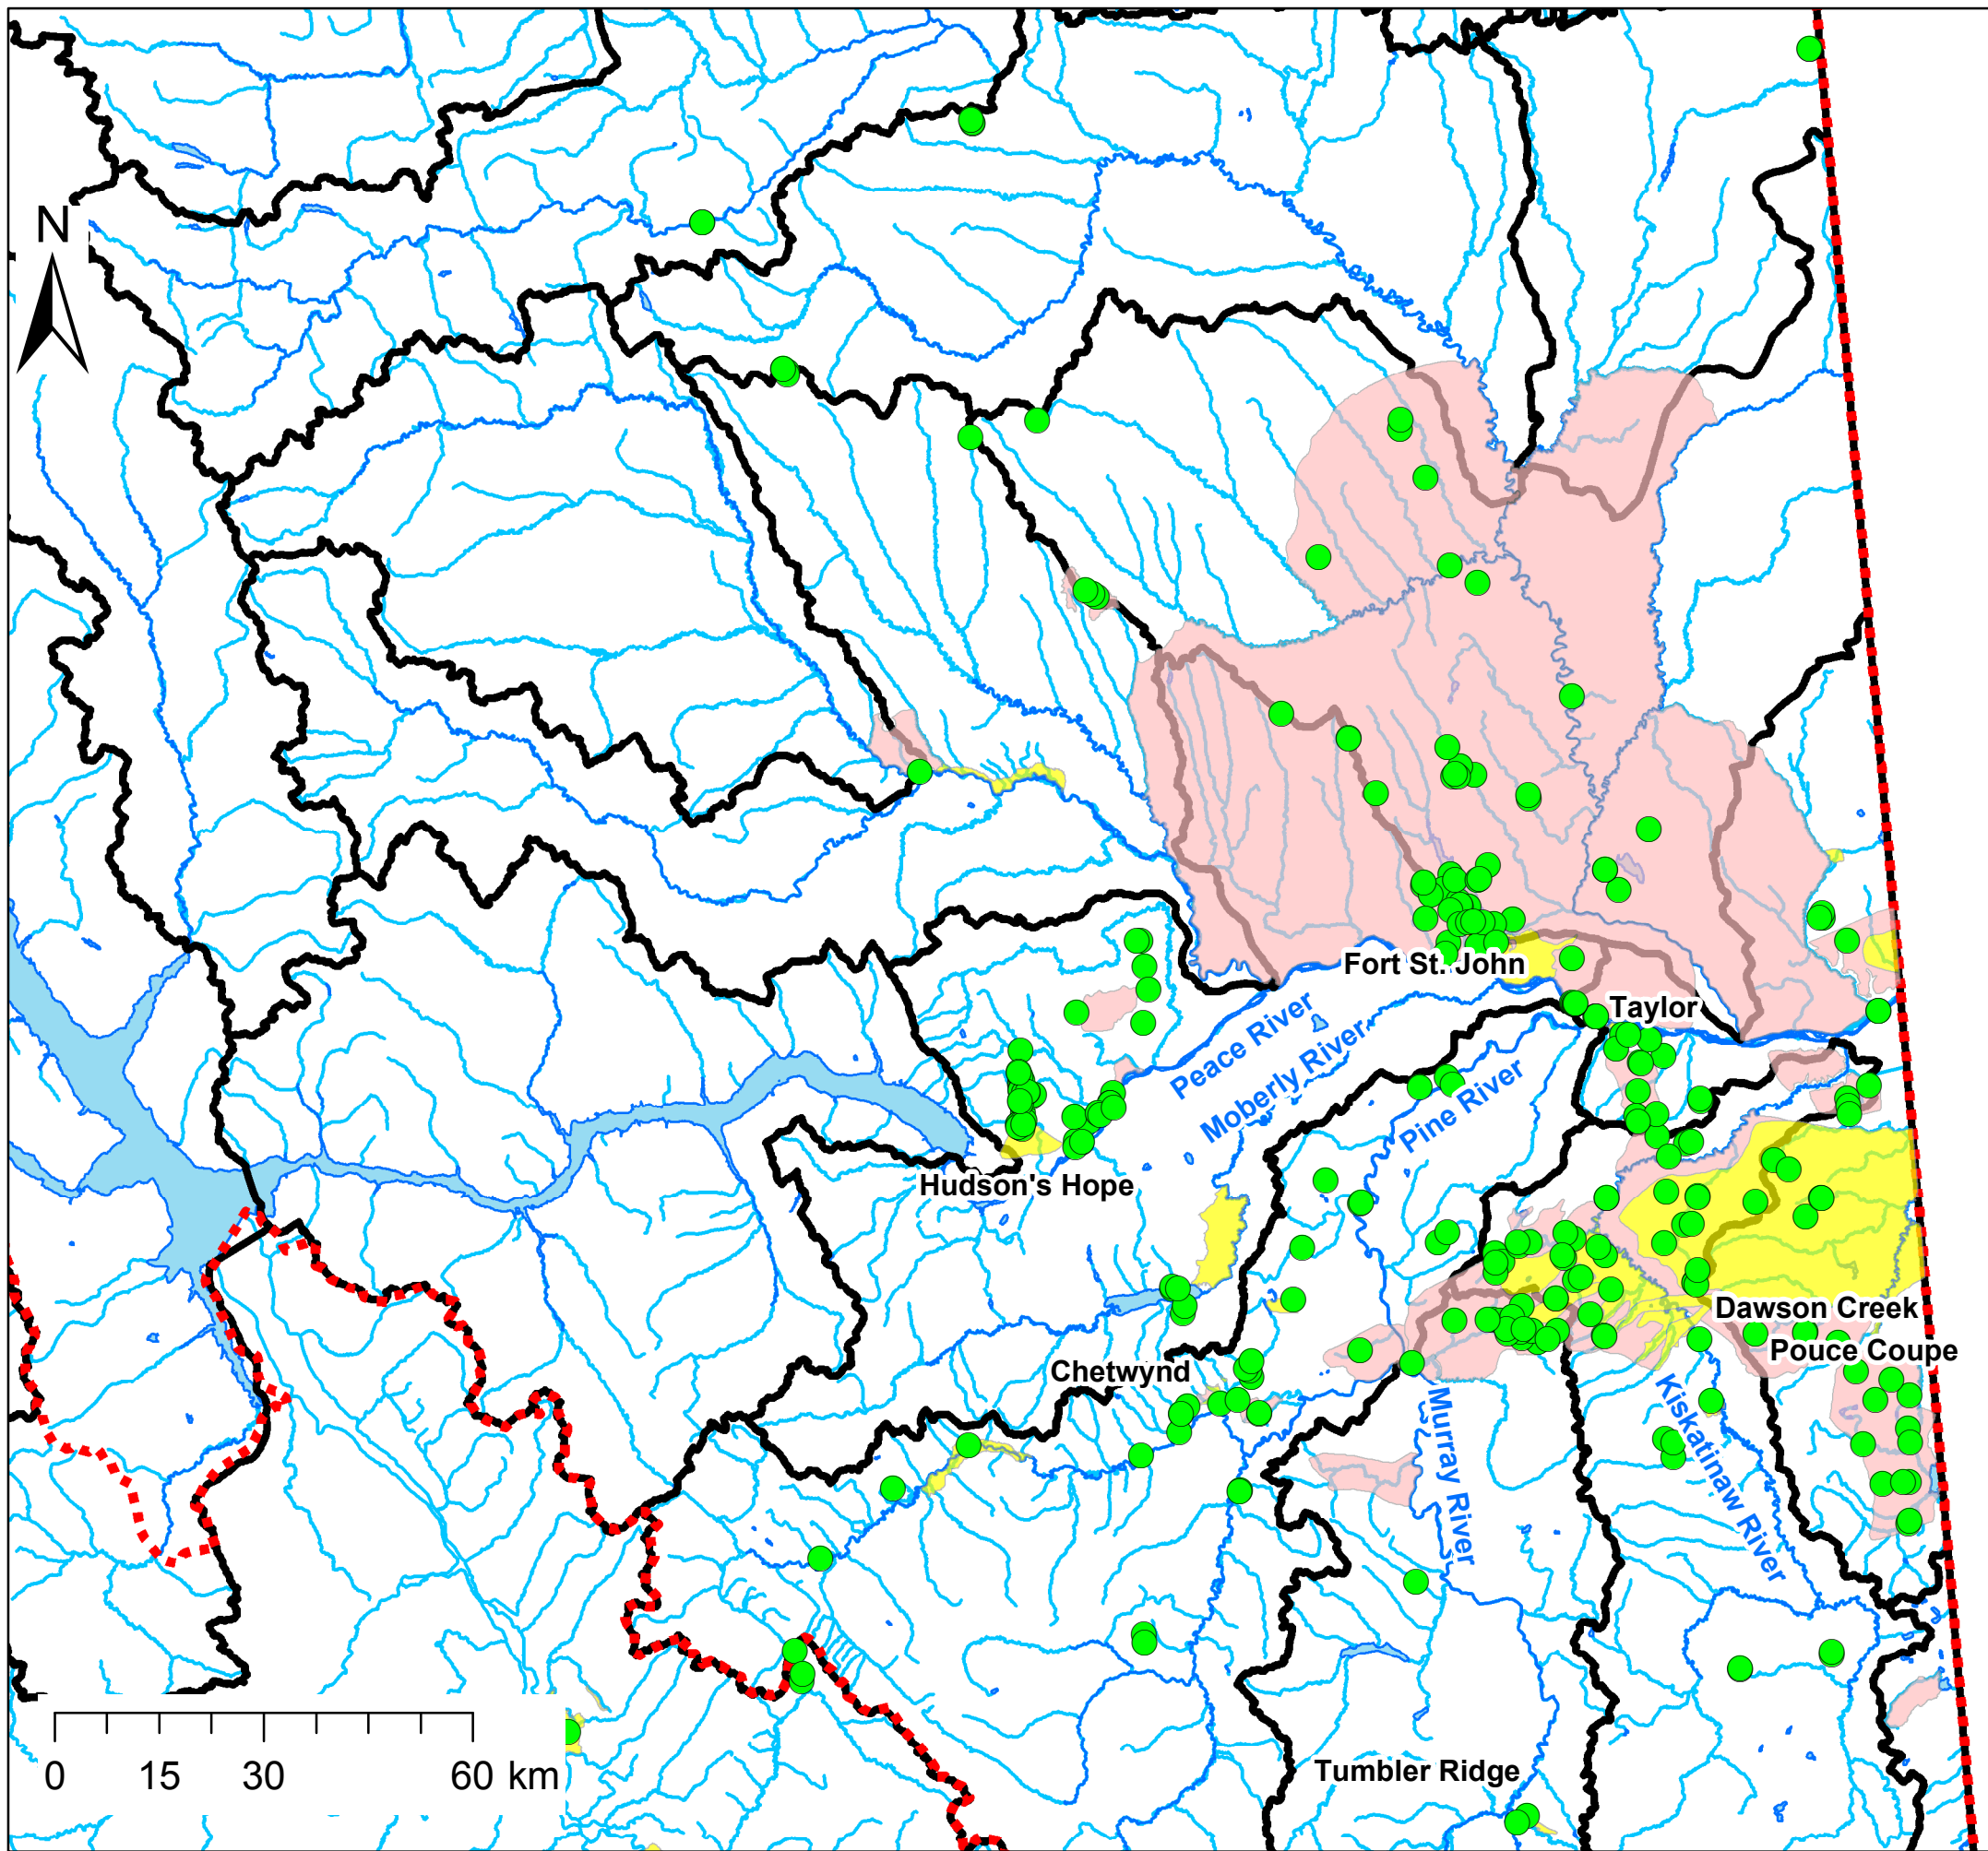**Exceedance analysis  
for aluminum dissolved (Al)**





**Legend**

-  PRRD boundary
-  Watershed boundary
-  Main Streams






**Mapped aquifers**

**Aquifer type**

-  Bedrock
-  Overburden


**GW Provincial drinking water (BCMoE)**

**% of samples exceeding guideline**




-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

**Exceedance analysis  
for boron (B)**

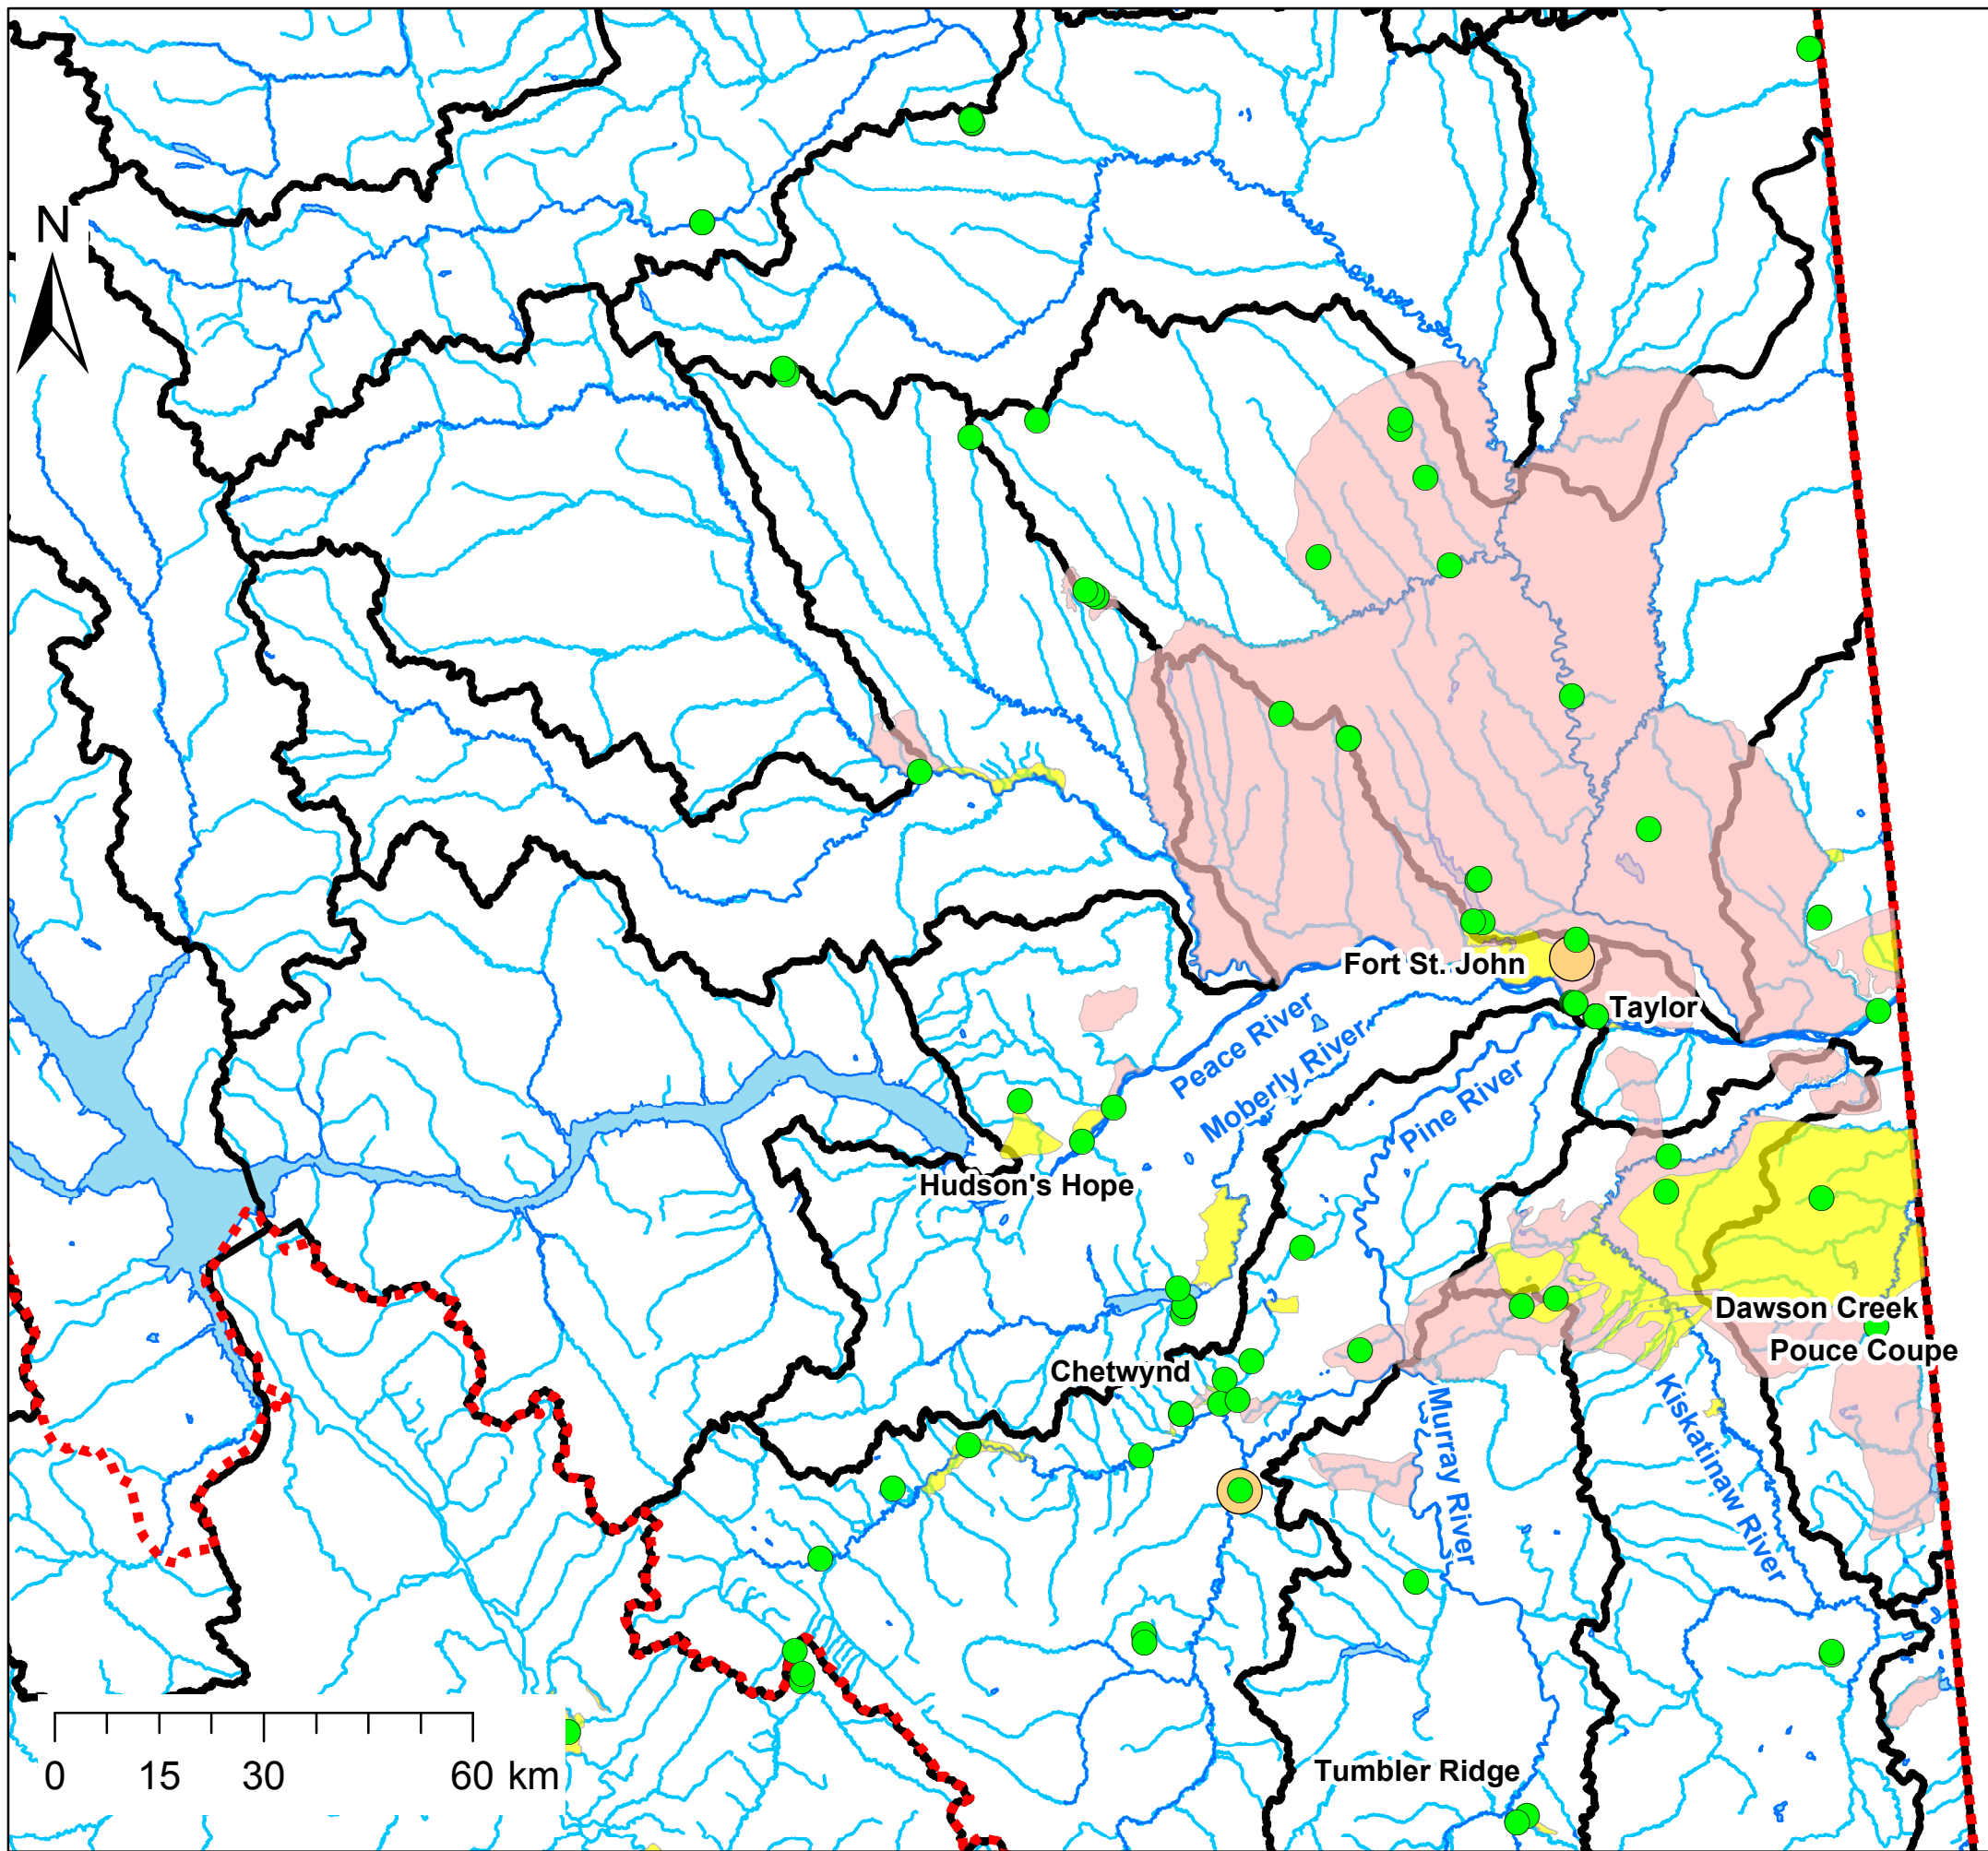





**Legend**

-  PRRD boundary
-  Watershed boundary
-  Main Streams






**Mapped aquifers**

**Aquifer type**


-  Bedrock
-  Overburden

**GW Provincial drinking water (BCMoE)**




**% of samples exceeding guideline**

-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

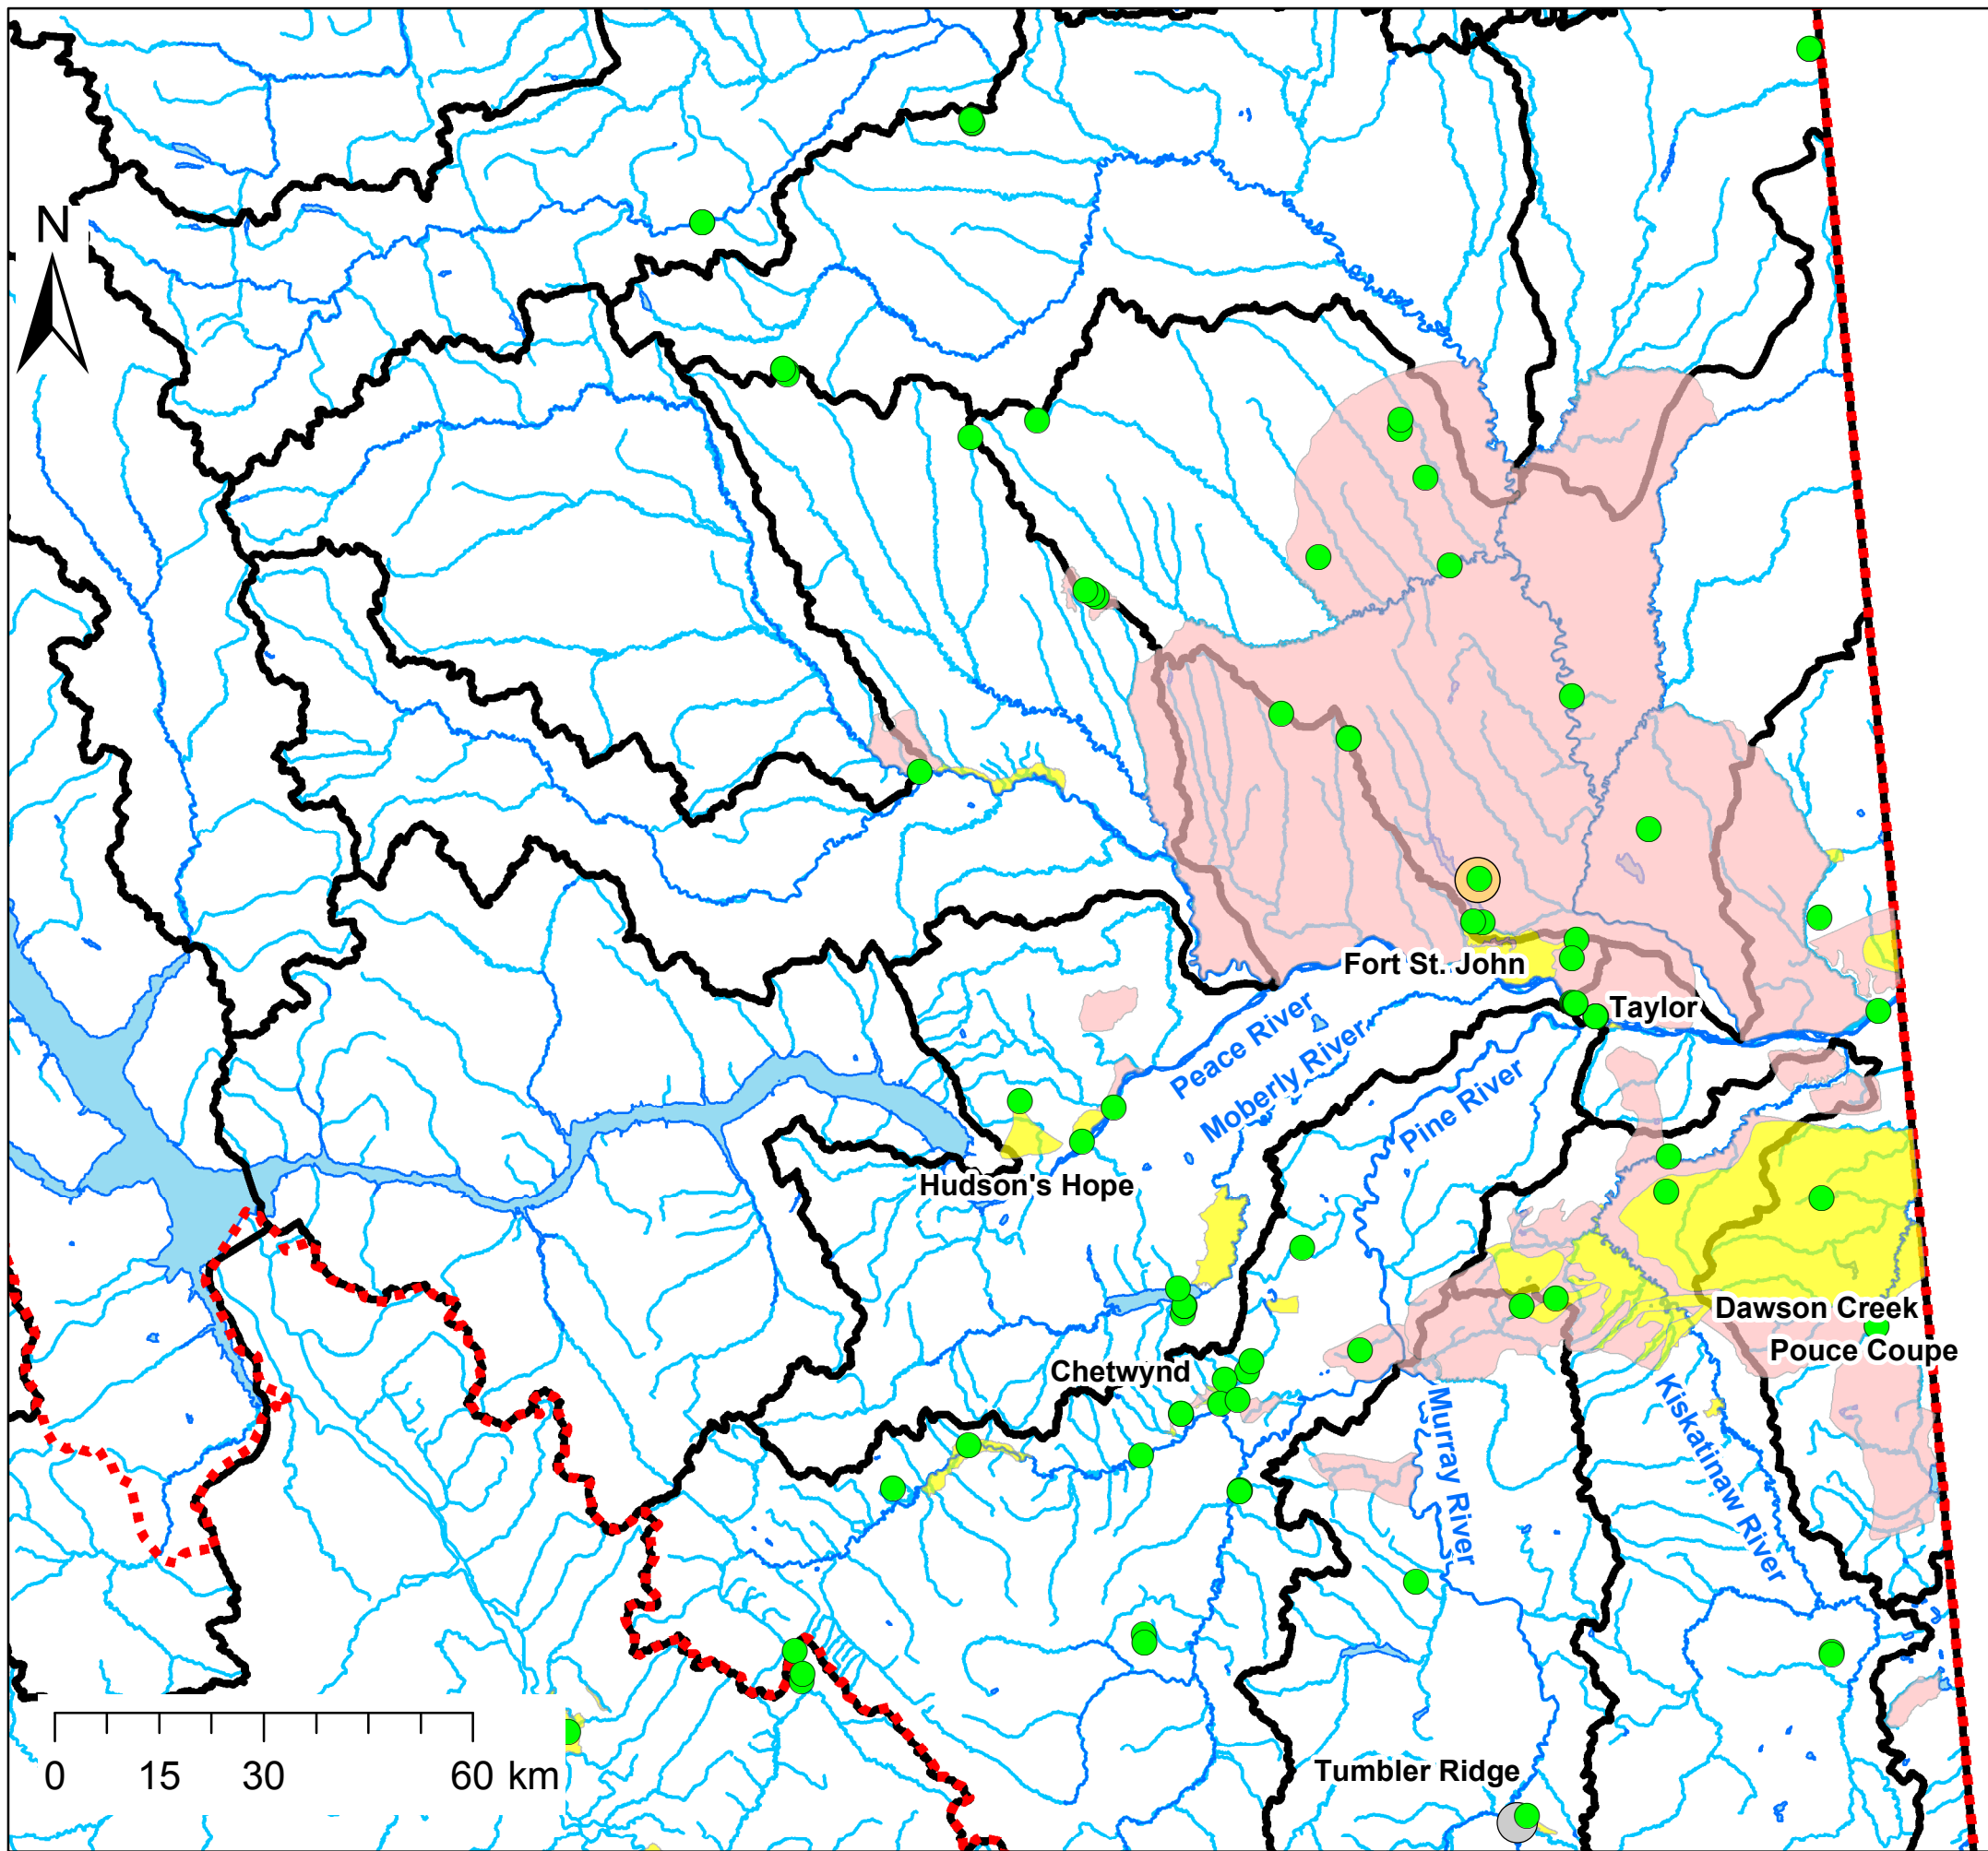**Exceedance analysis  
for copper (Cu)**




**Legend**

-  PRRD boundary
-  Watershed boundary
-  Main Streams






**Mapped aquifers**

**Aquifer type**

-  Bedrock
-  Overburden


**GW Provincial drinking water (BCMoE)**

**% of samples exceeding guideline**




-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

**Exceedance analysis  
for lead (Pb)**

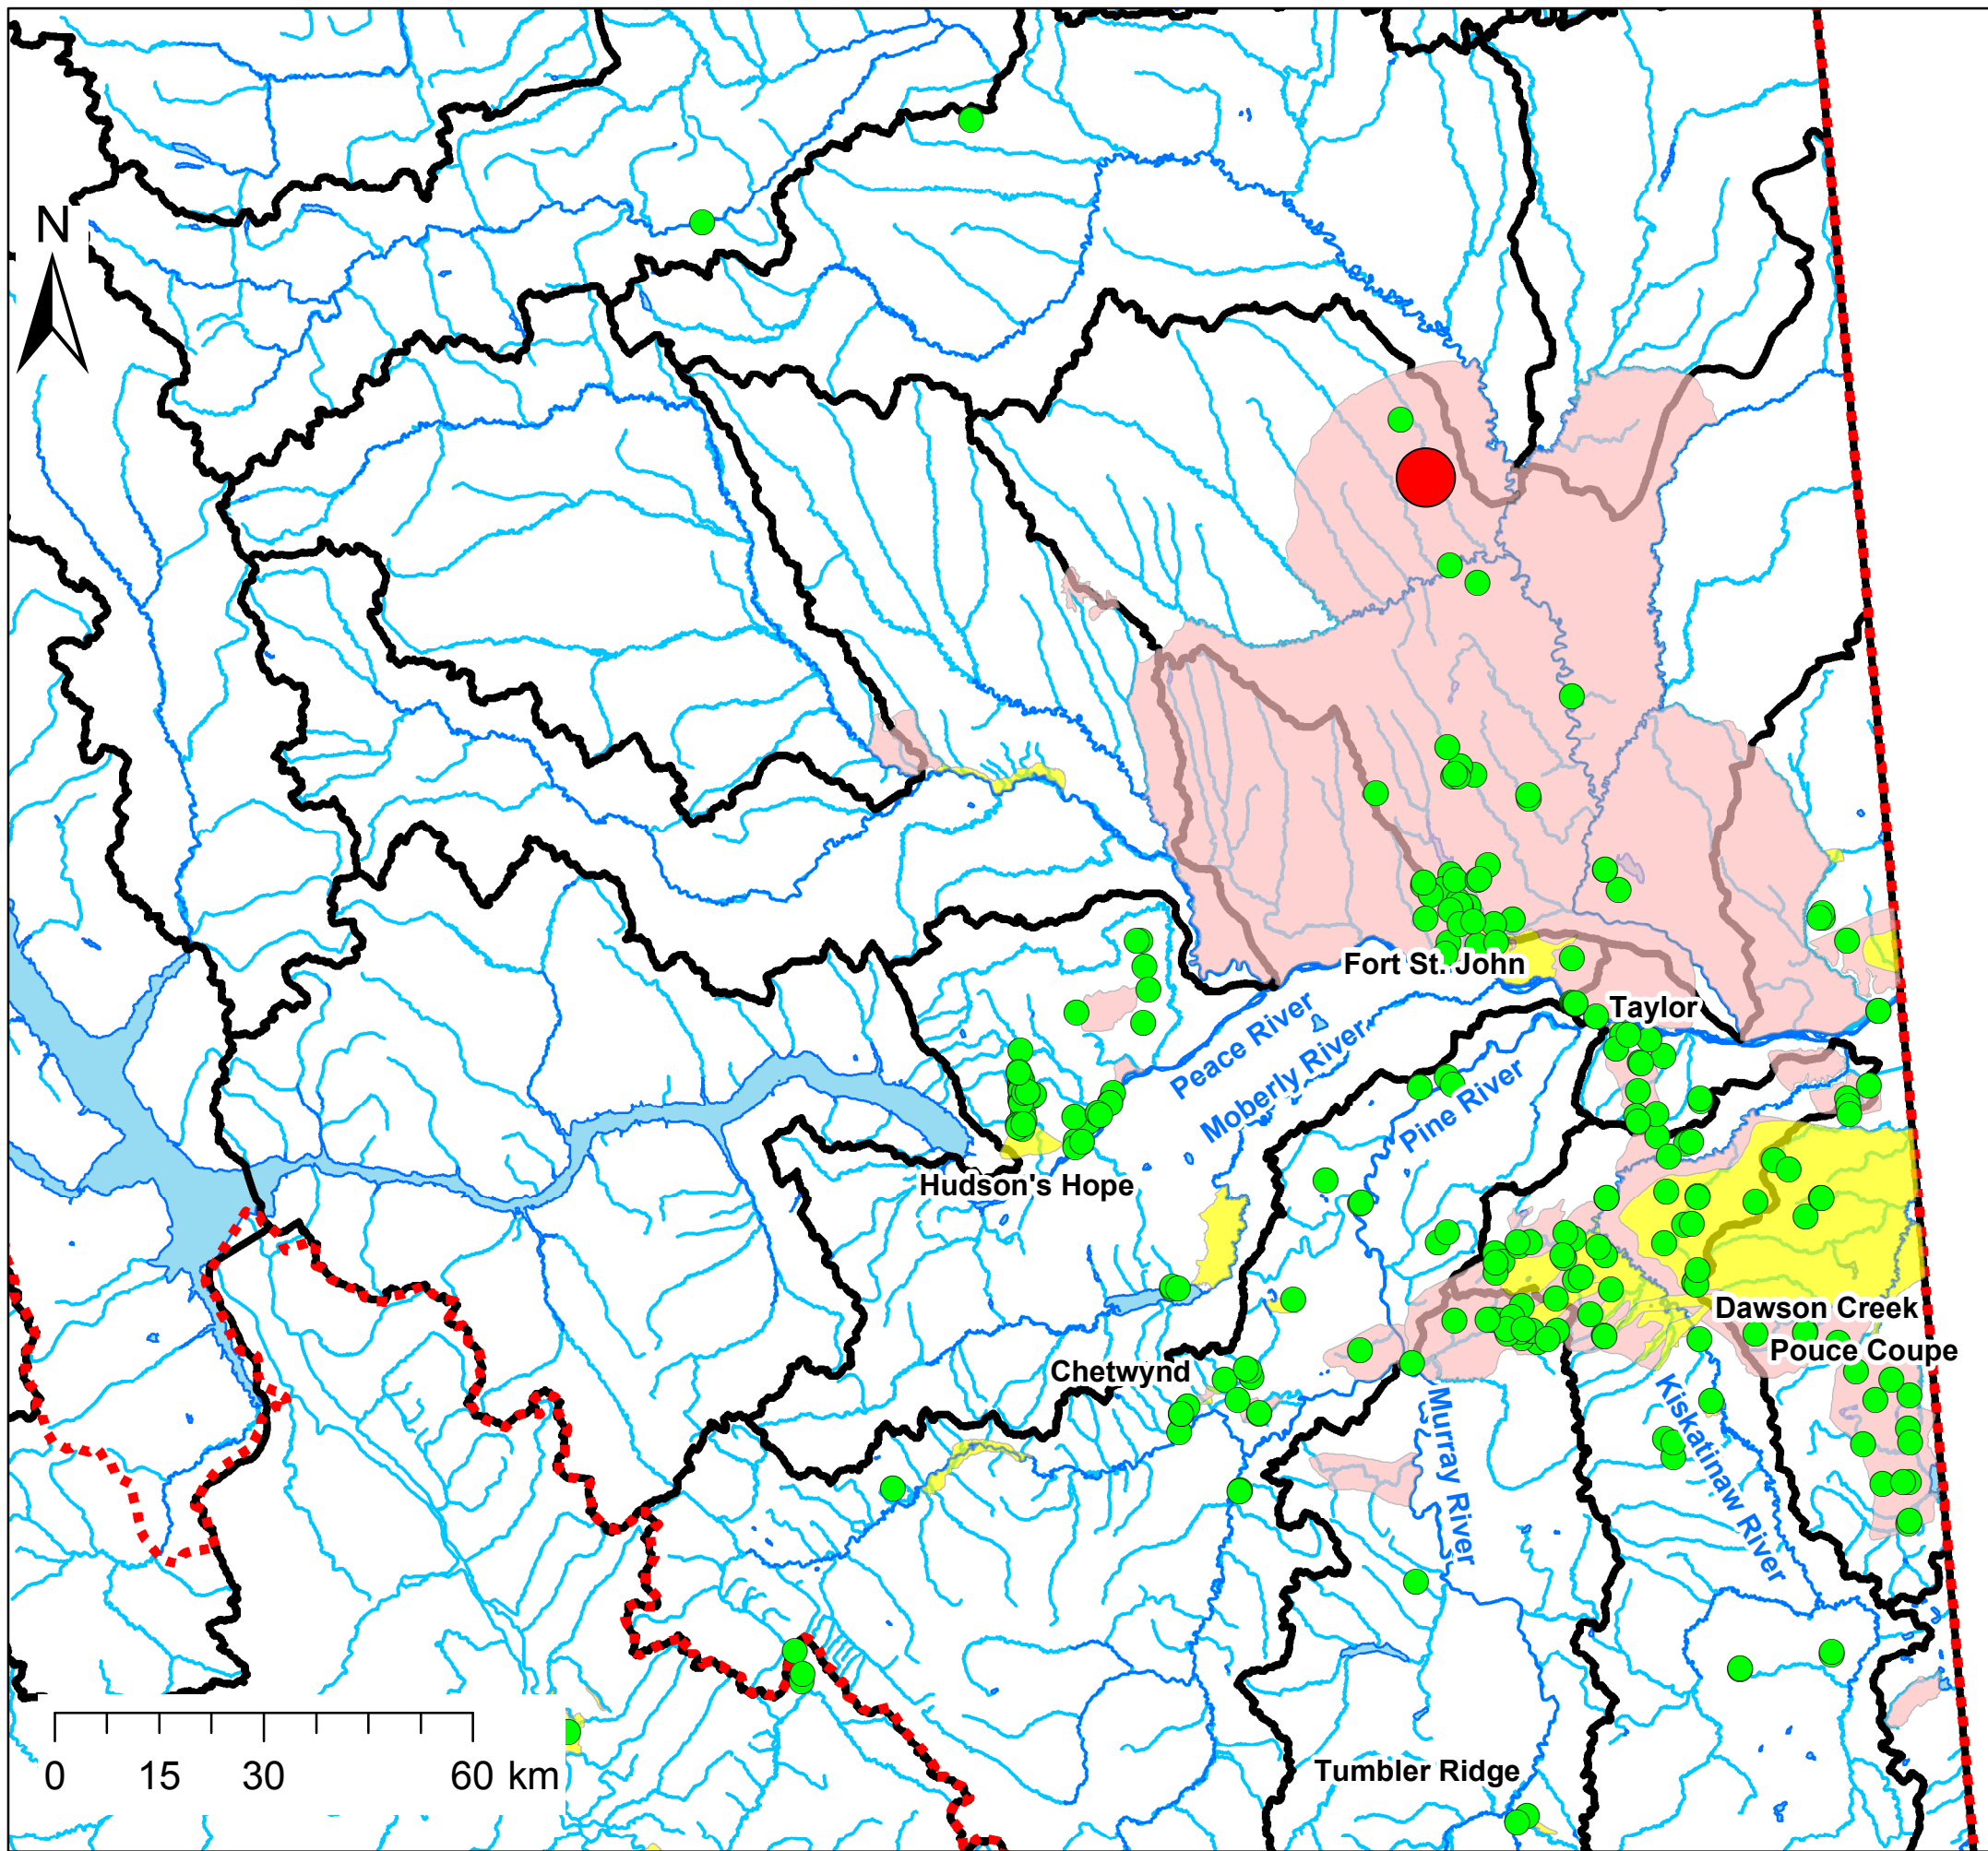





**Legend**

-  PRRD boundary
-  Watershed boundary
-  Main Streams






**Mapped aquifers**

**Aquifer type**


-  Bedrock
-  Overburden

**GW Provincial drinking water (BCMoE)**




**% of samples exceeding guideline**

-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

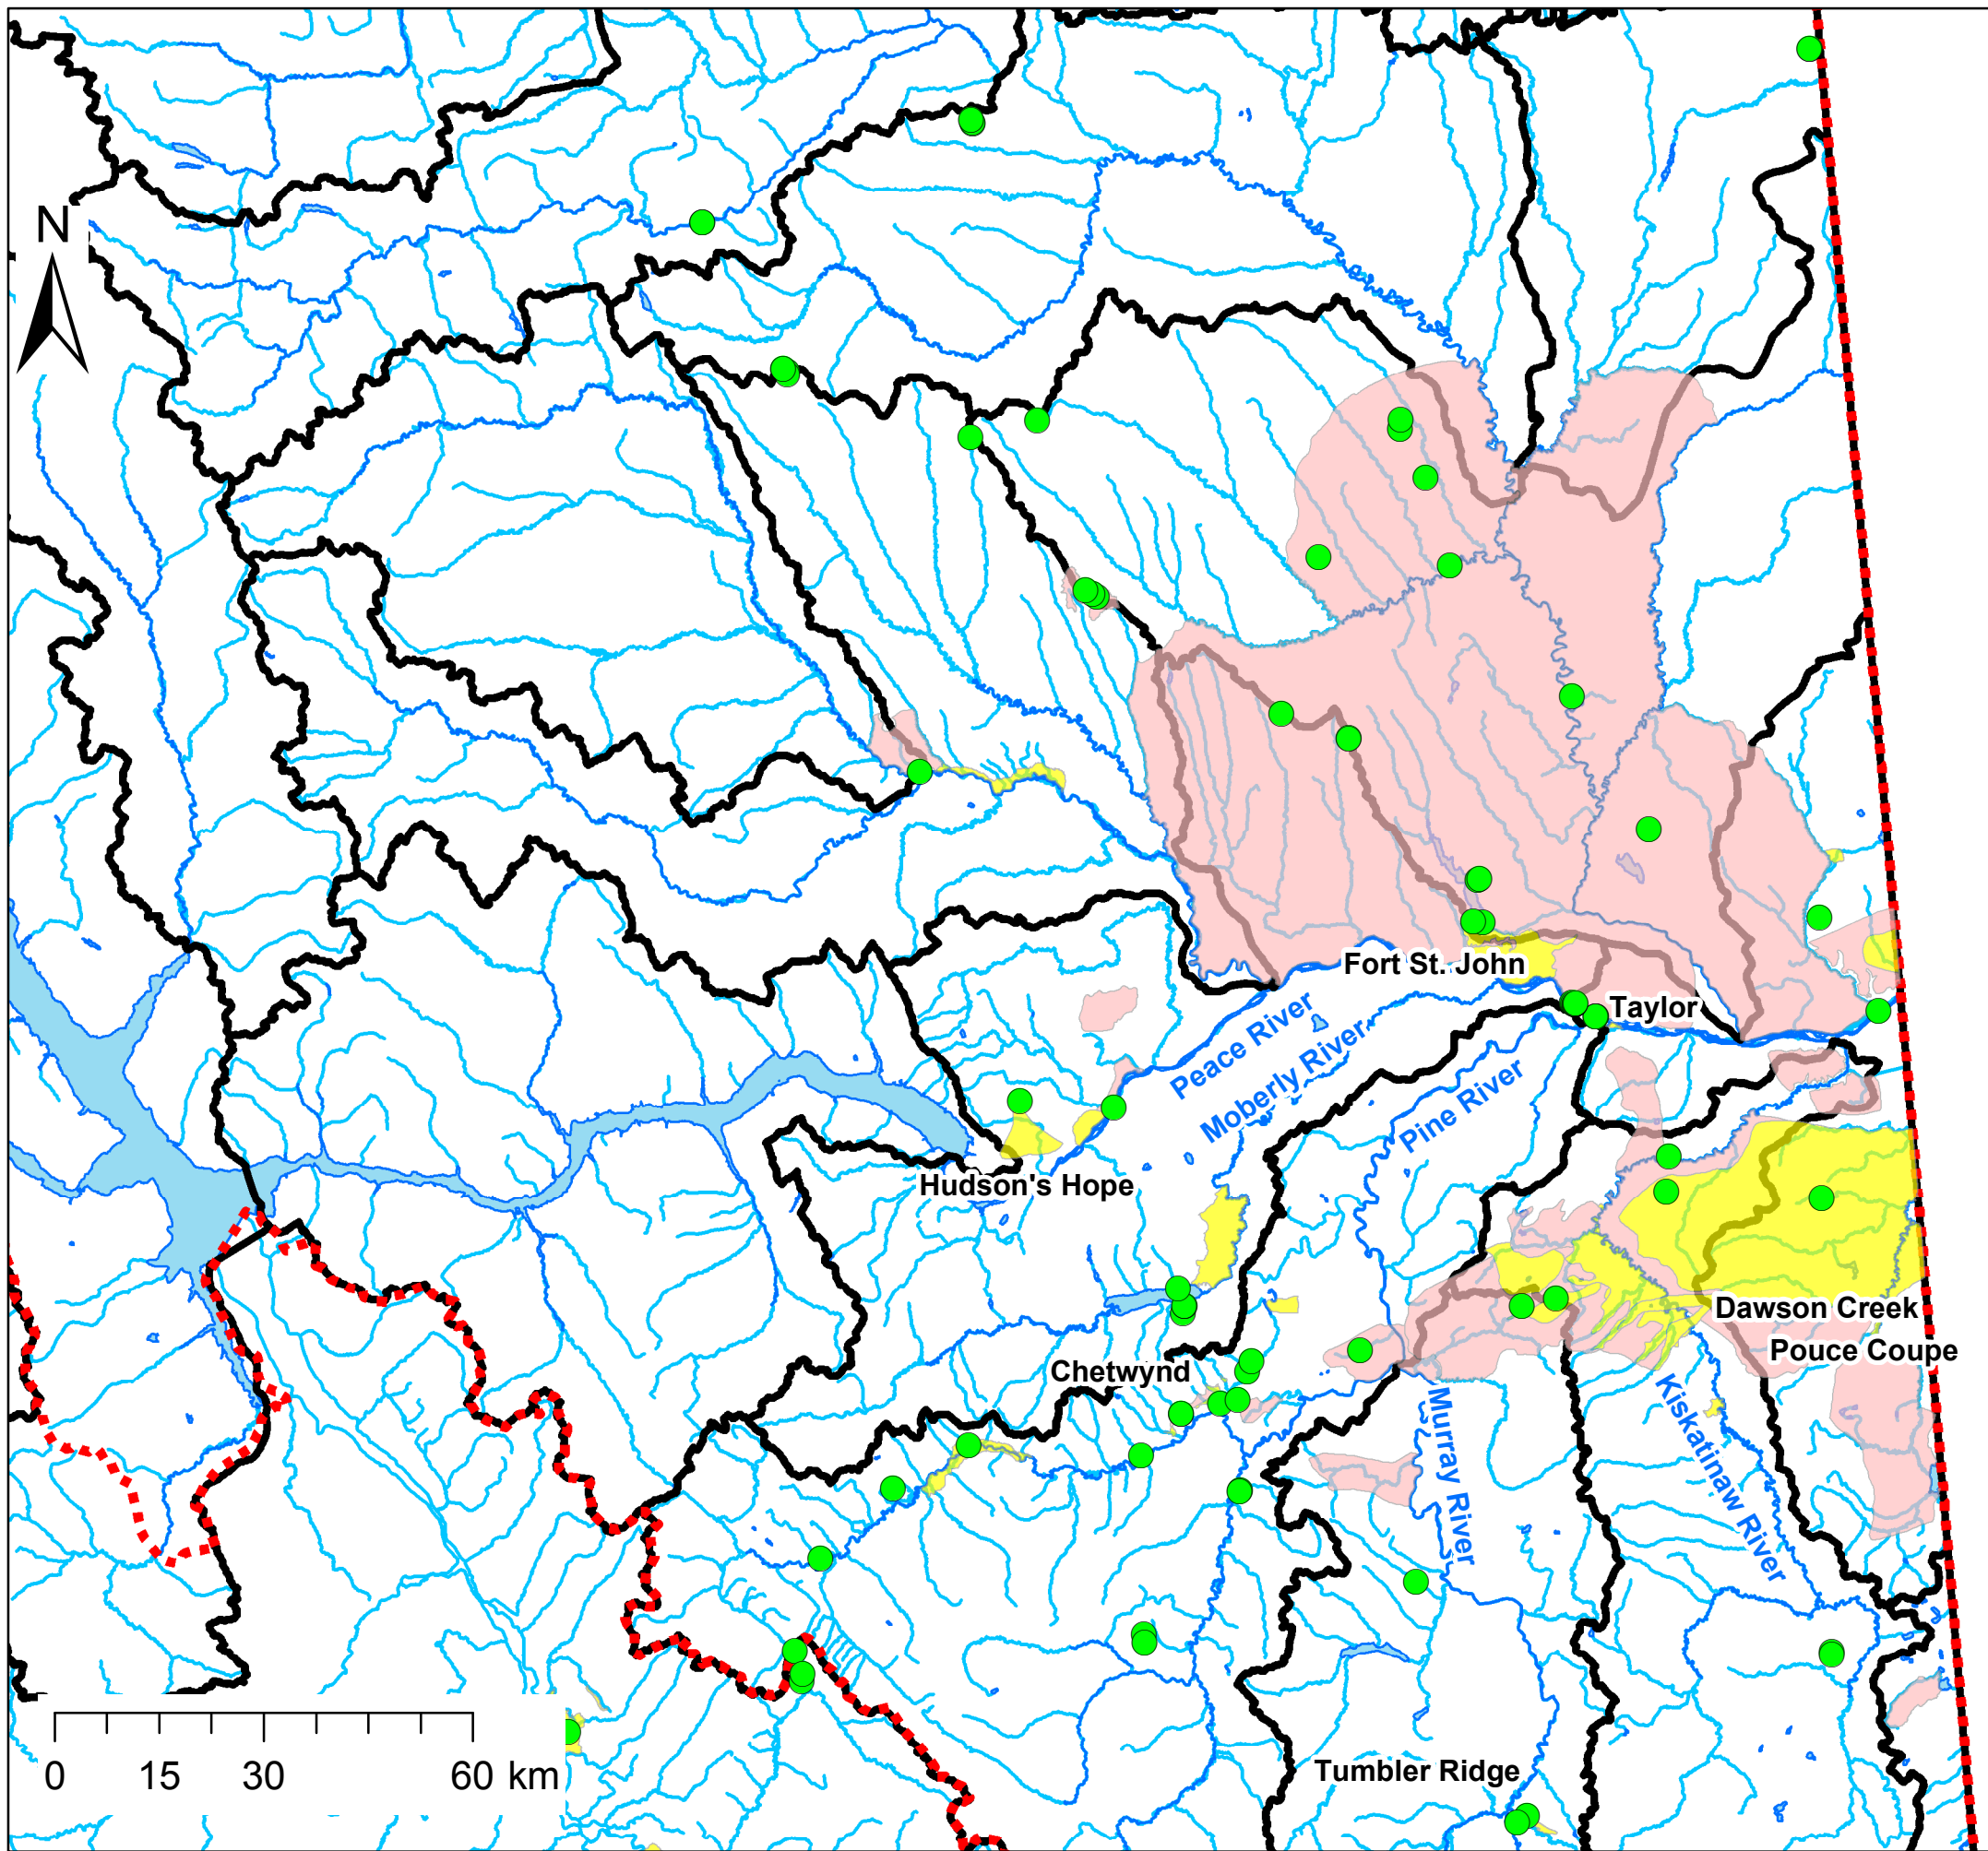**Exceedance analysis for molybdenum (Mo)**




**Legend**

-  PRRD boundary
-  Watershed boundary
-  Main Streams






**Mapped aquifers**

**Aquifer type**

-  Bedrock
-  Overburden


**GW Provincial drinking water (BCMoE)**

**% of samples exceeding guideline**




-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

**Exceedance analysis for selenium (Se)**

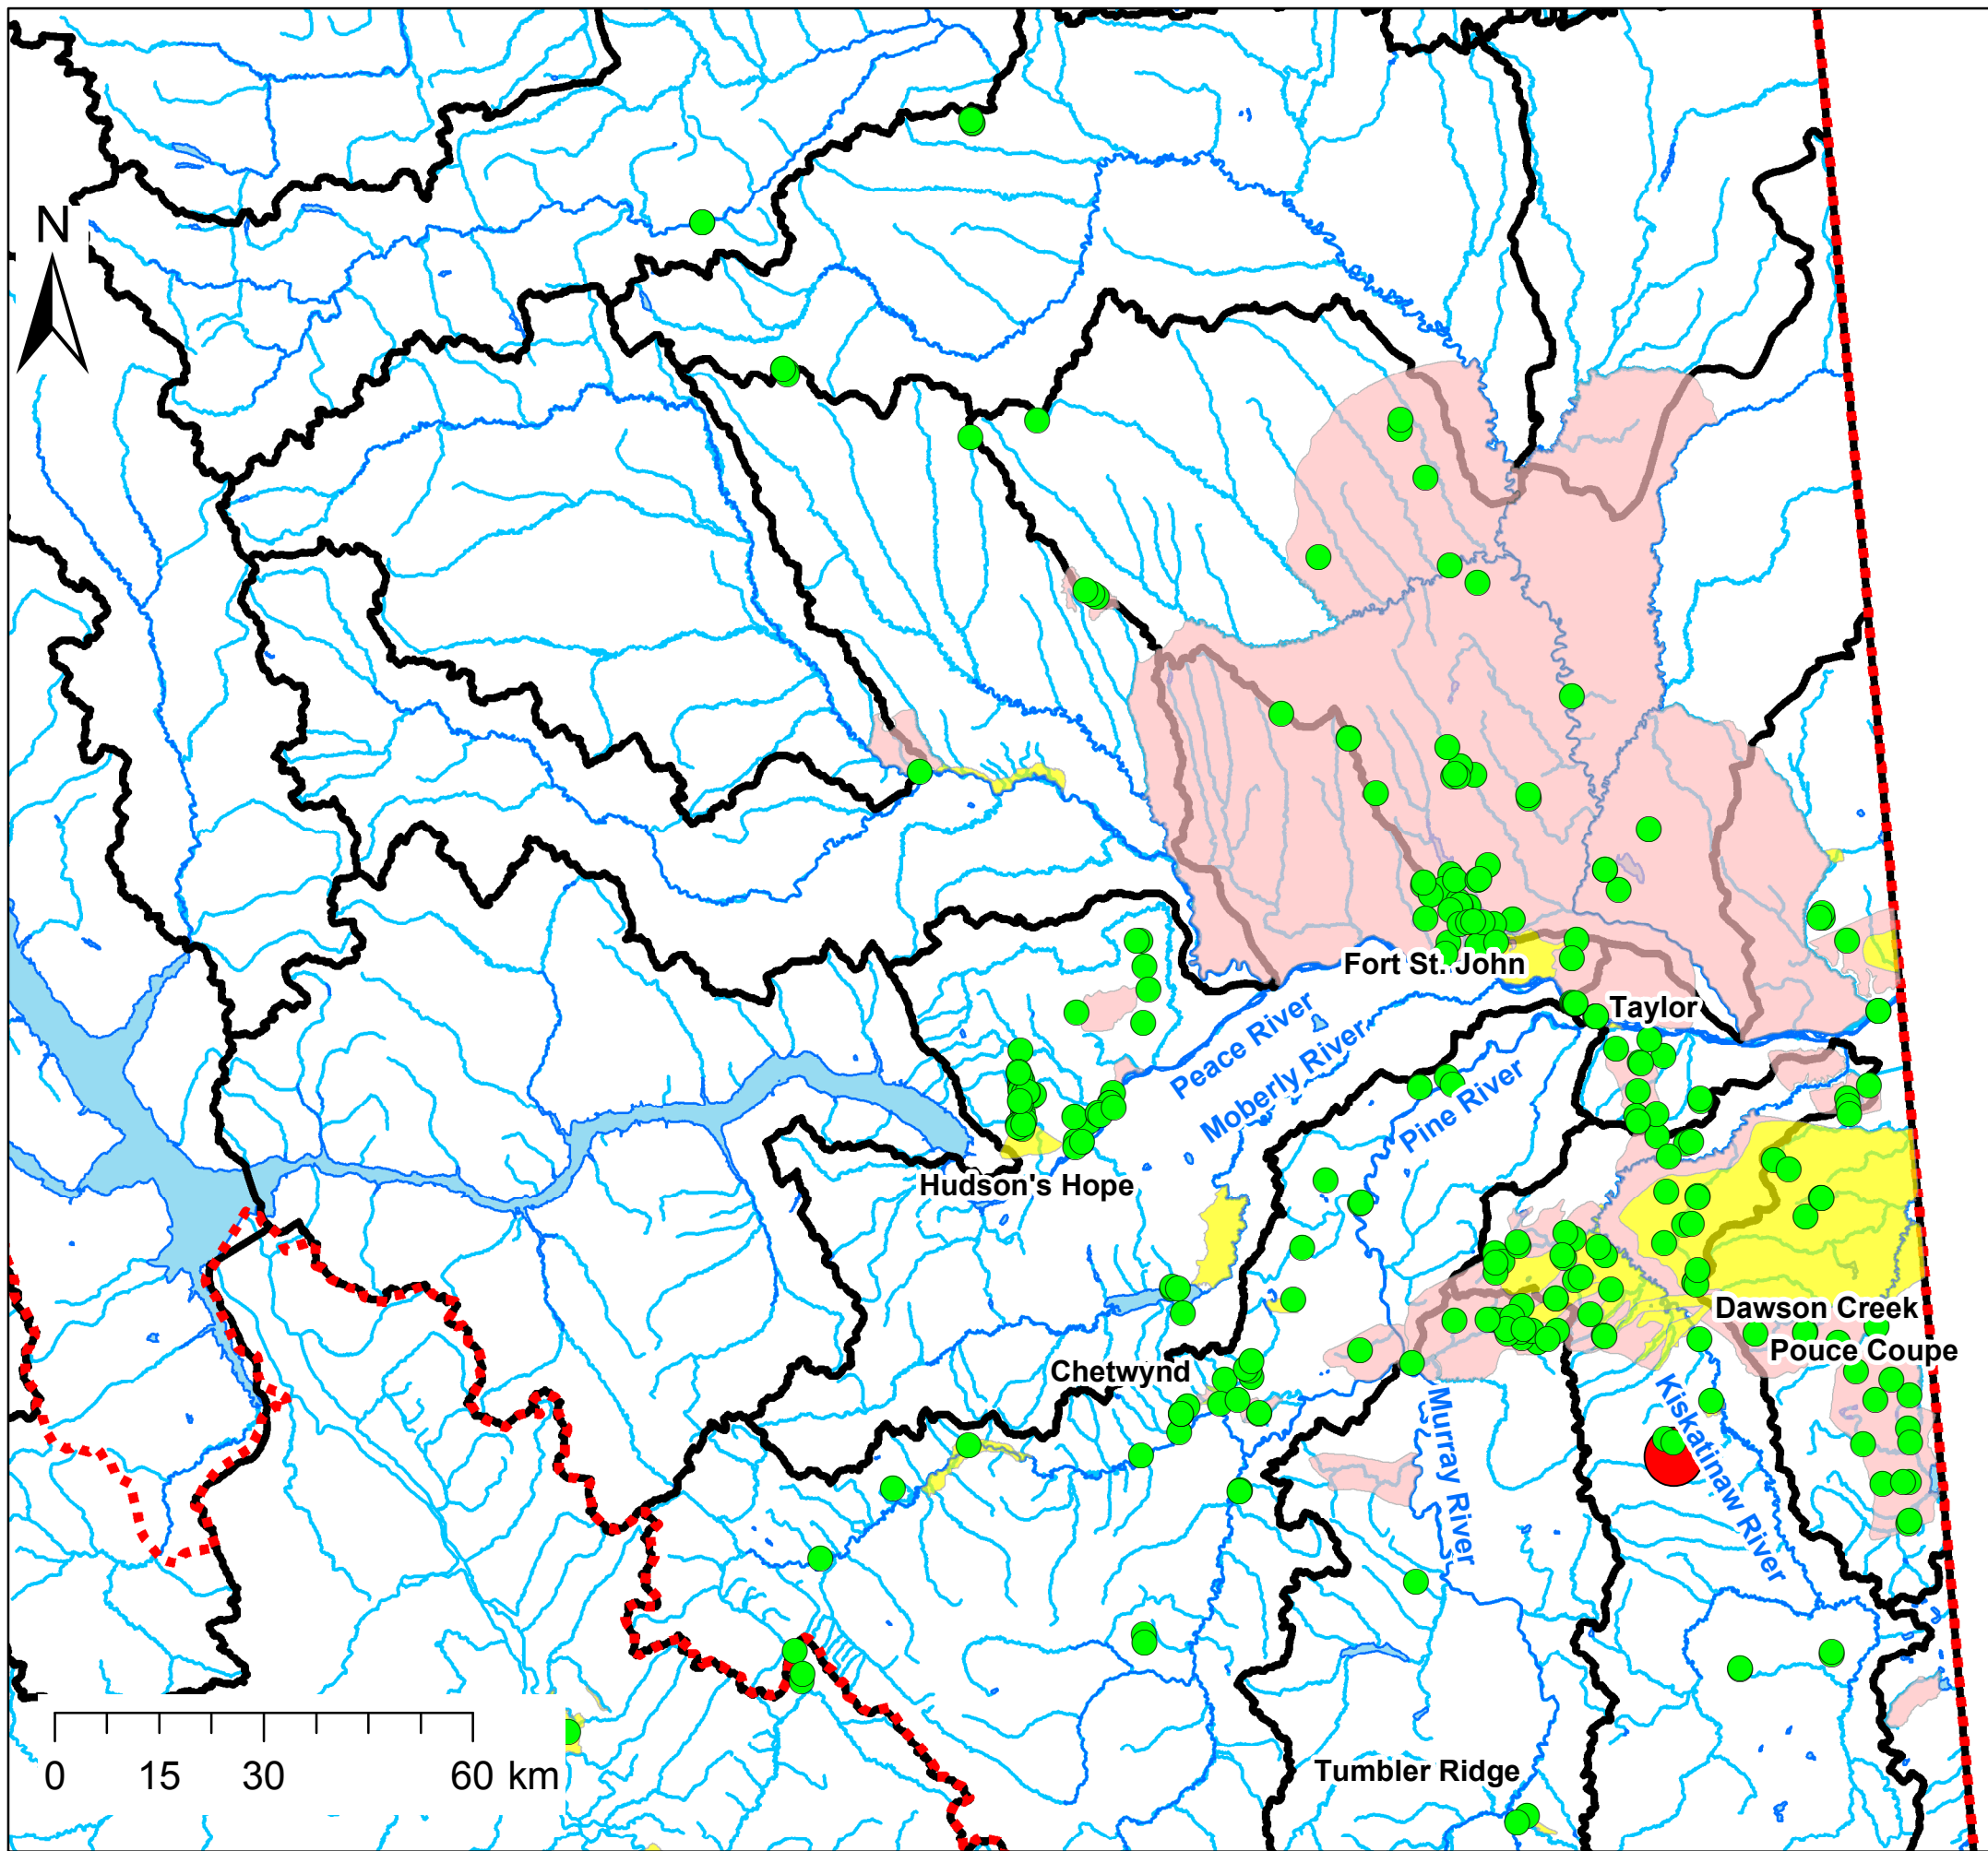





**Legend**

-  PRRD boundary
-  Watershed boundary
-  Main Streams






**Mapped aquifers**

**Aquifer type**


-  Bedrock
-  Overburden

**GW Provincial drinking water (BCMoE)**




**% of samples exceeding guideline**

-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

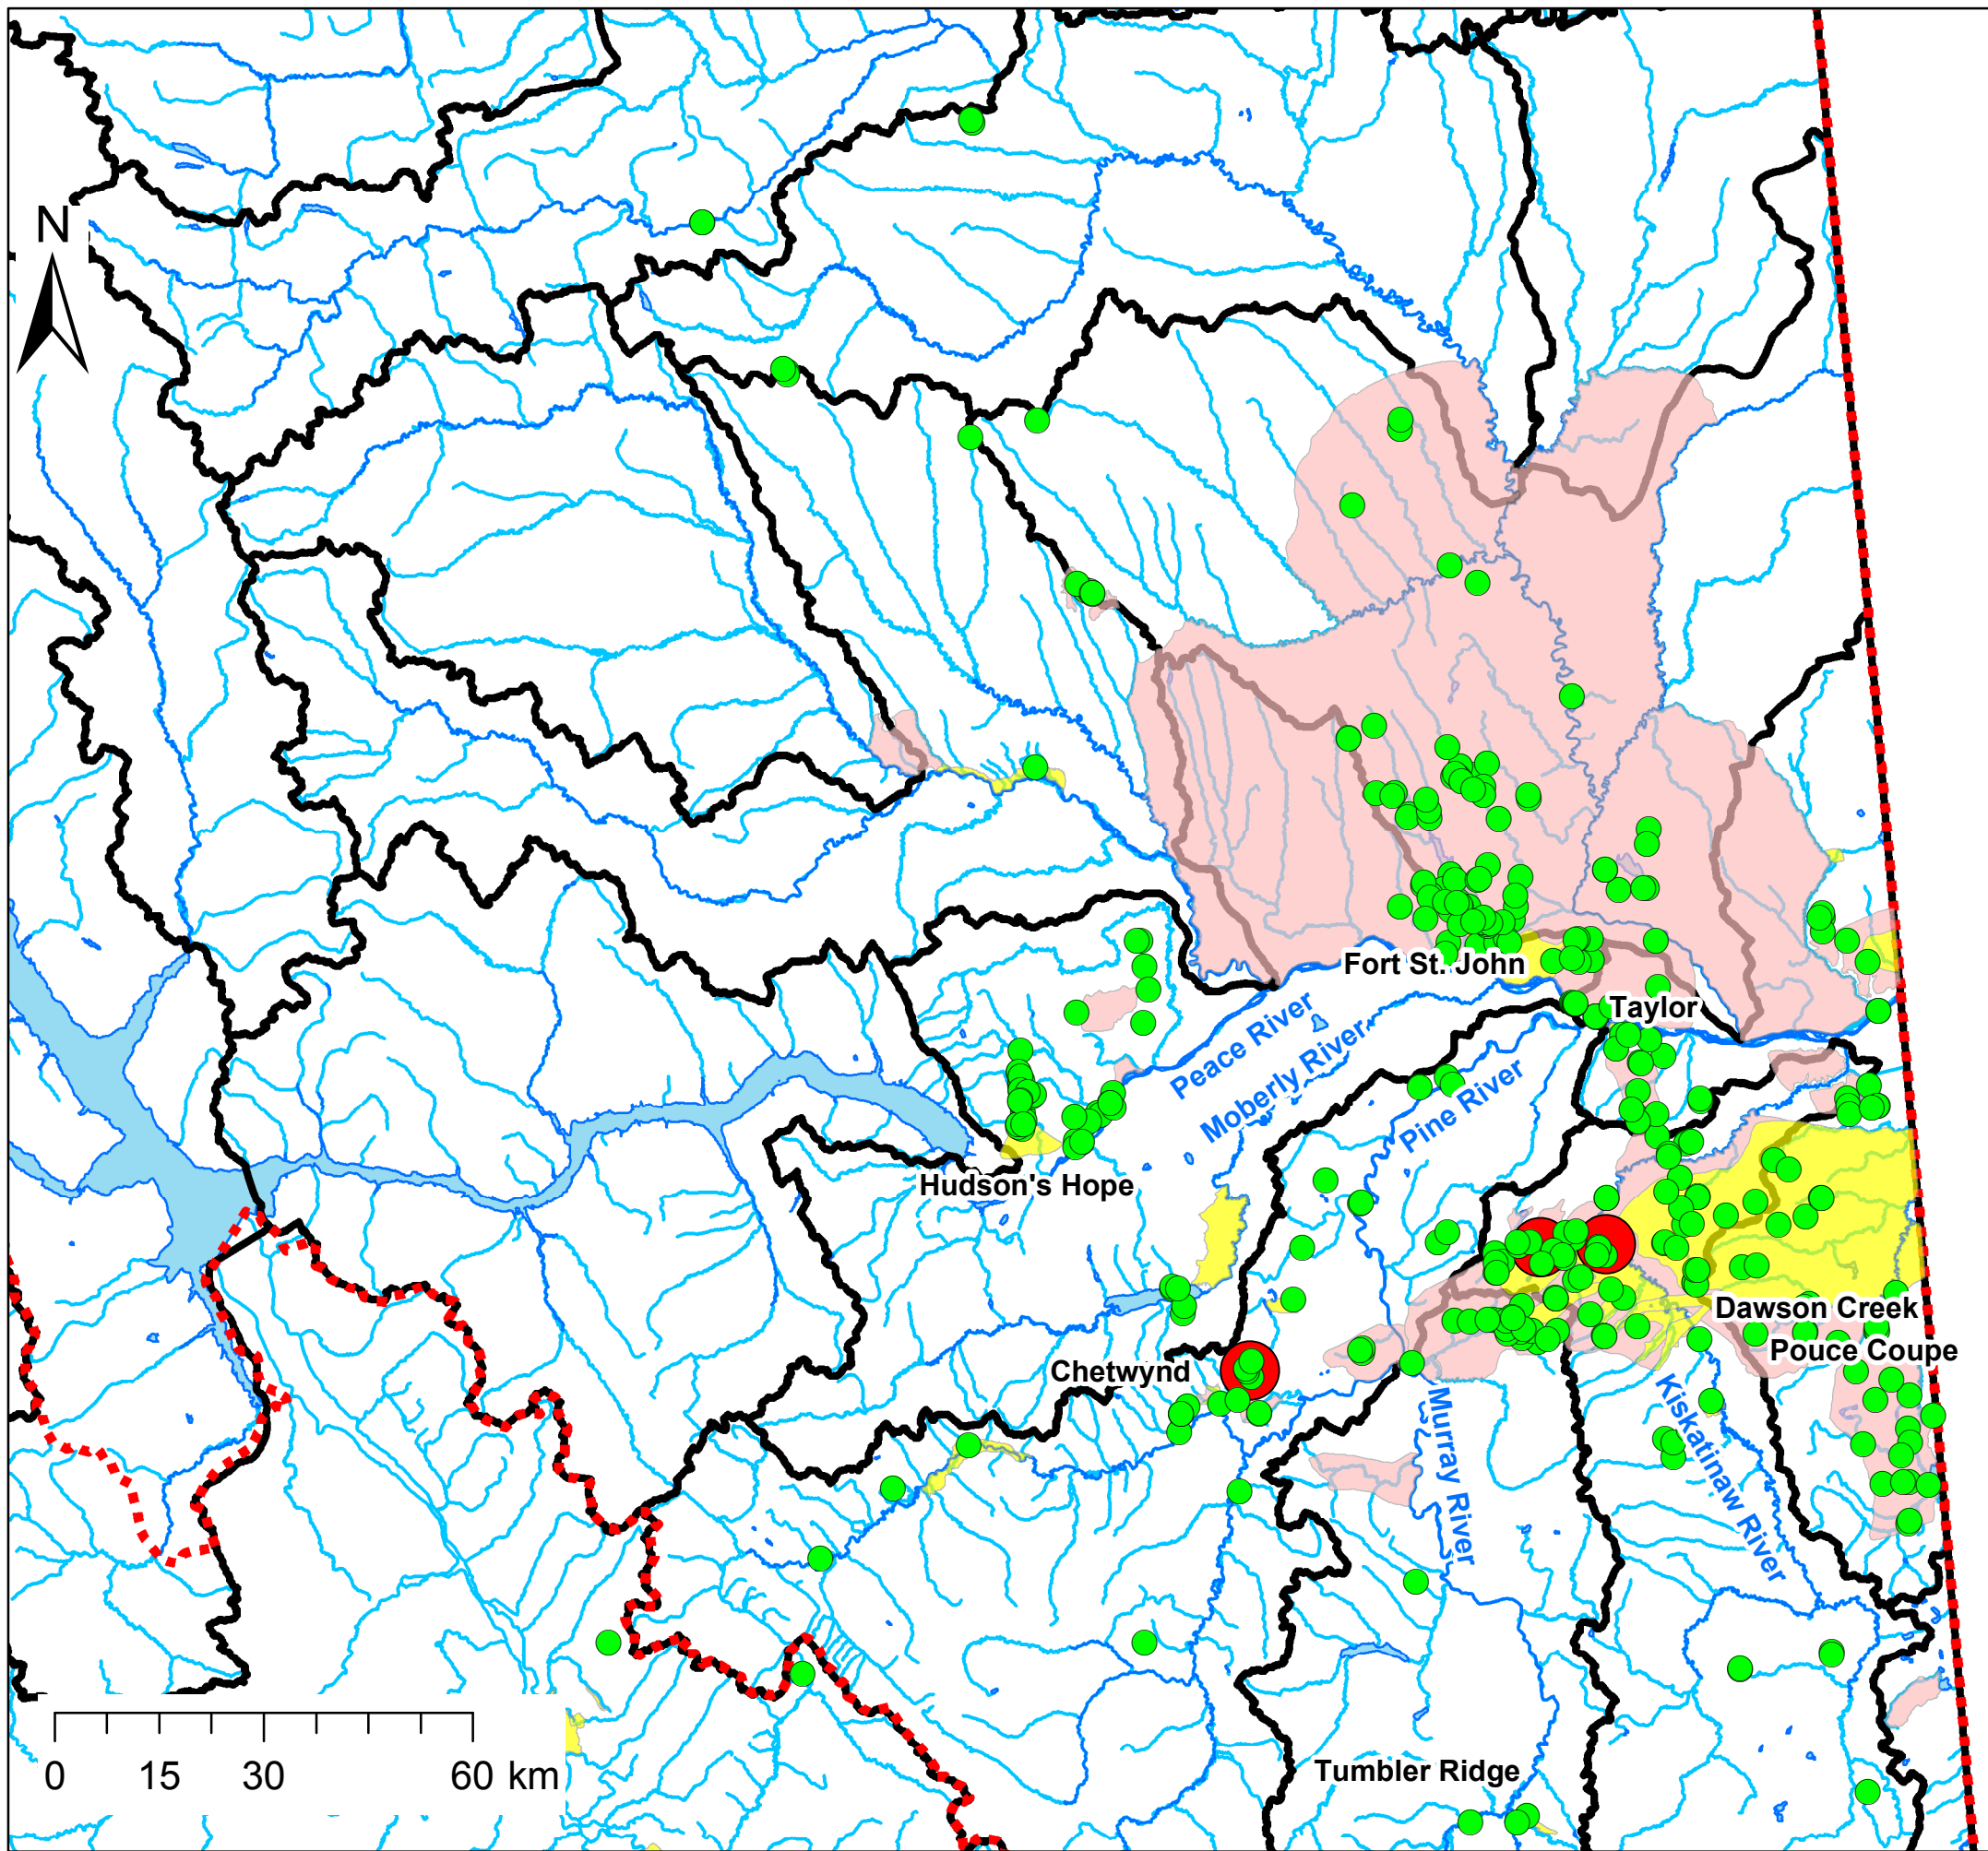**Exceedance analysis  
for zinc (Zn)**



**Legend**

-  PRRD boundary
-  Watershed boundary
-  Main Streams






**Mapped aquifers**

**Aquifer type**

-  Bedrock
-  Overburden


**GW Provincial drinking water (BCMoE)**

**% of samples exceeding guideline**




-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

**Exceedance analysis  
for chloride (Cl)**

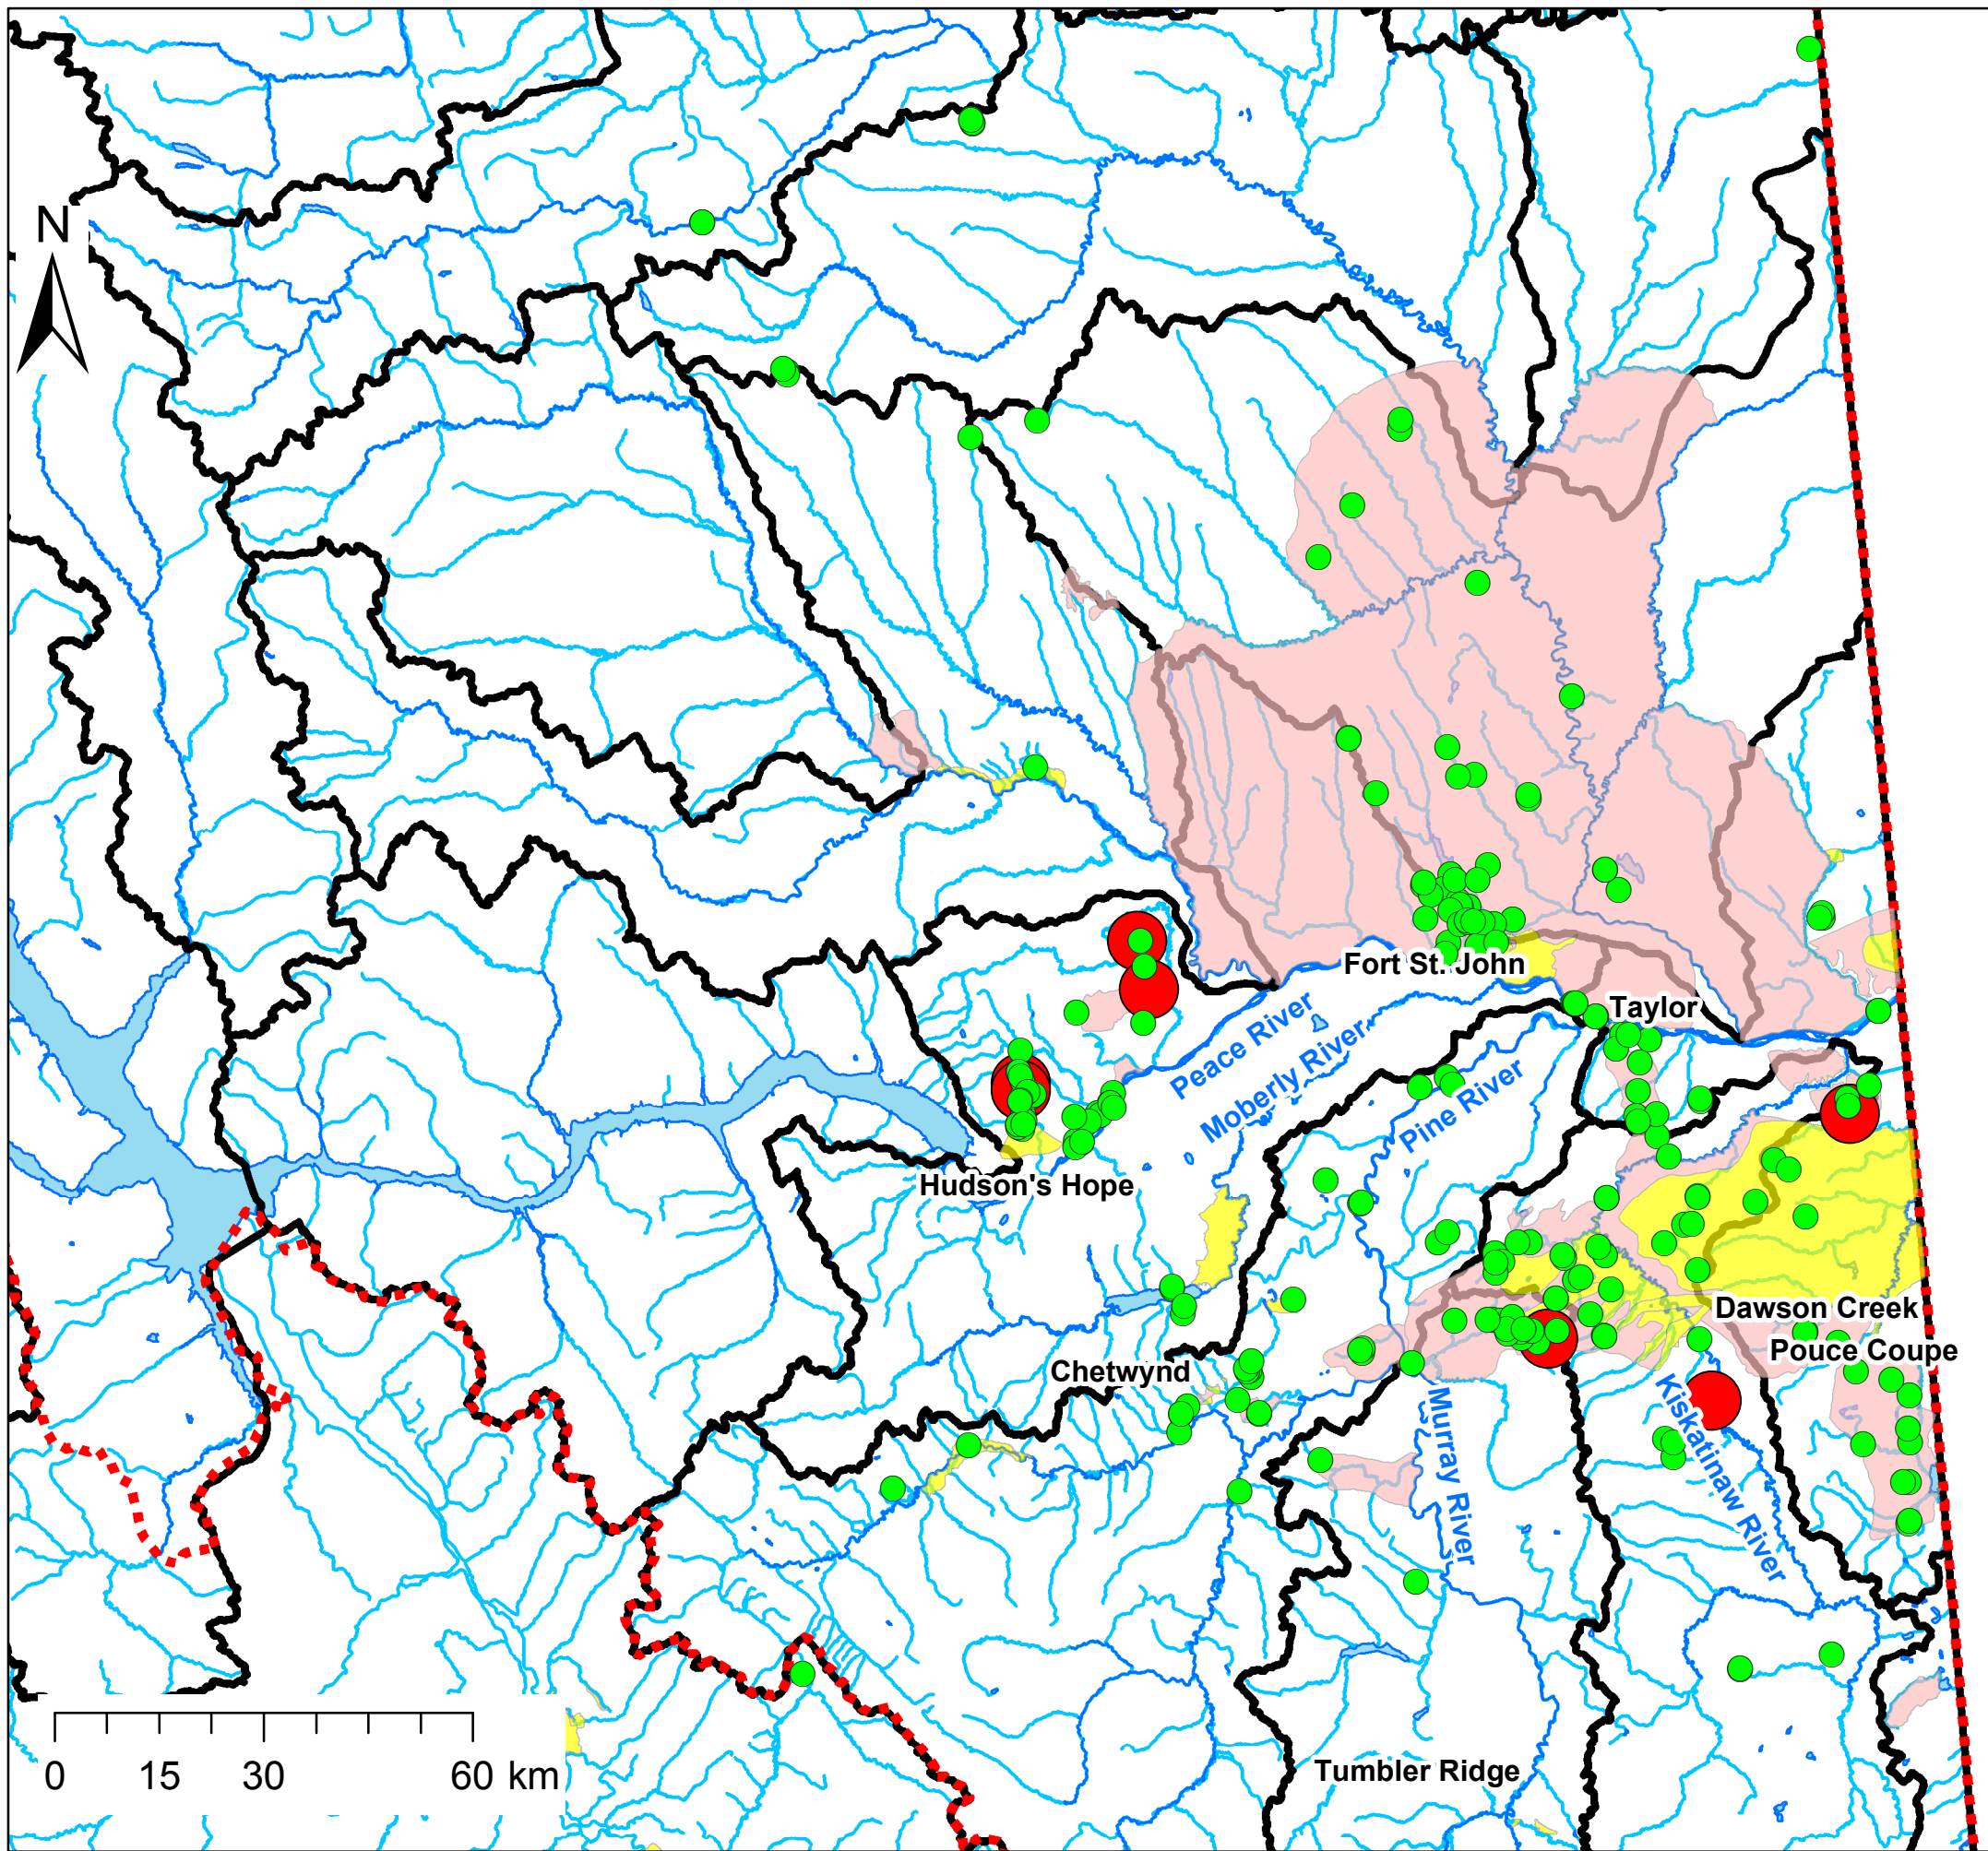



### Legend

-  PRRD boundary
-  Watershed boundary
-  Main Streams






### Mapped aquifers

#### Aquifer type


-  Bedrock
-  Overburden

### GW Provincial drinking water (BCMoE)




#### % of samples exceeding guideline

-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

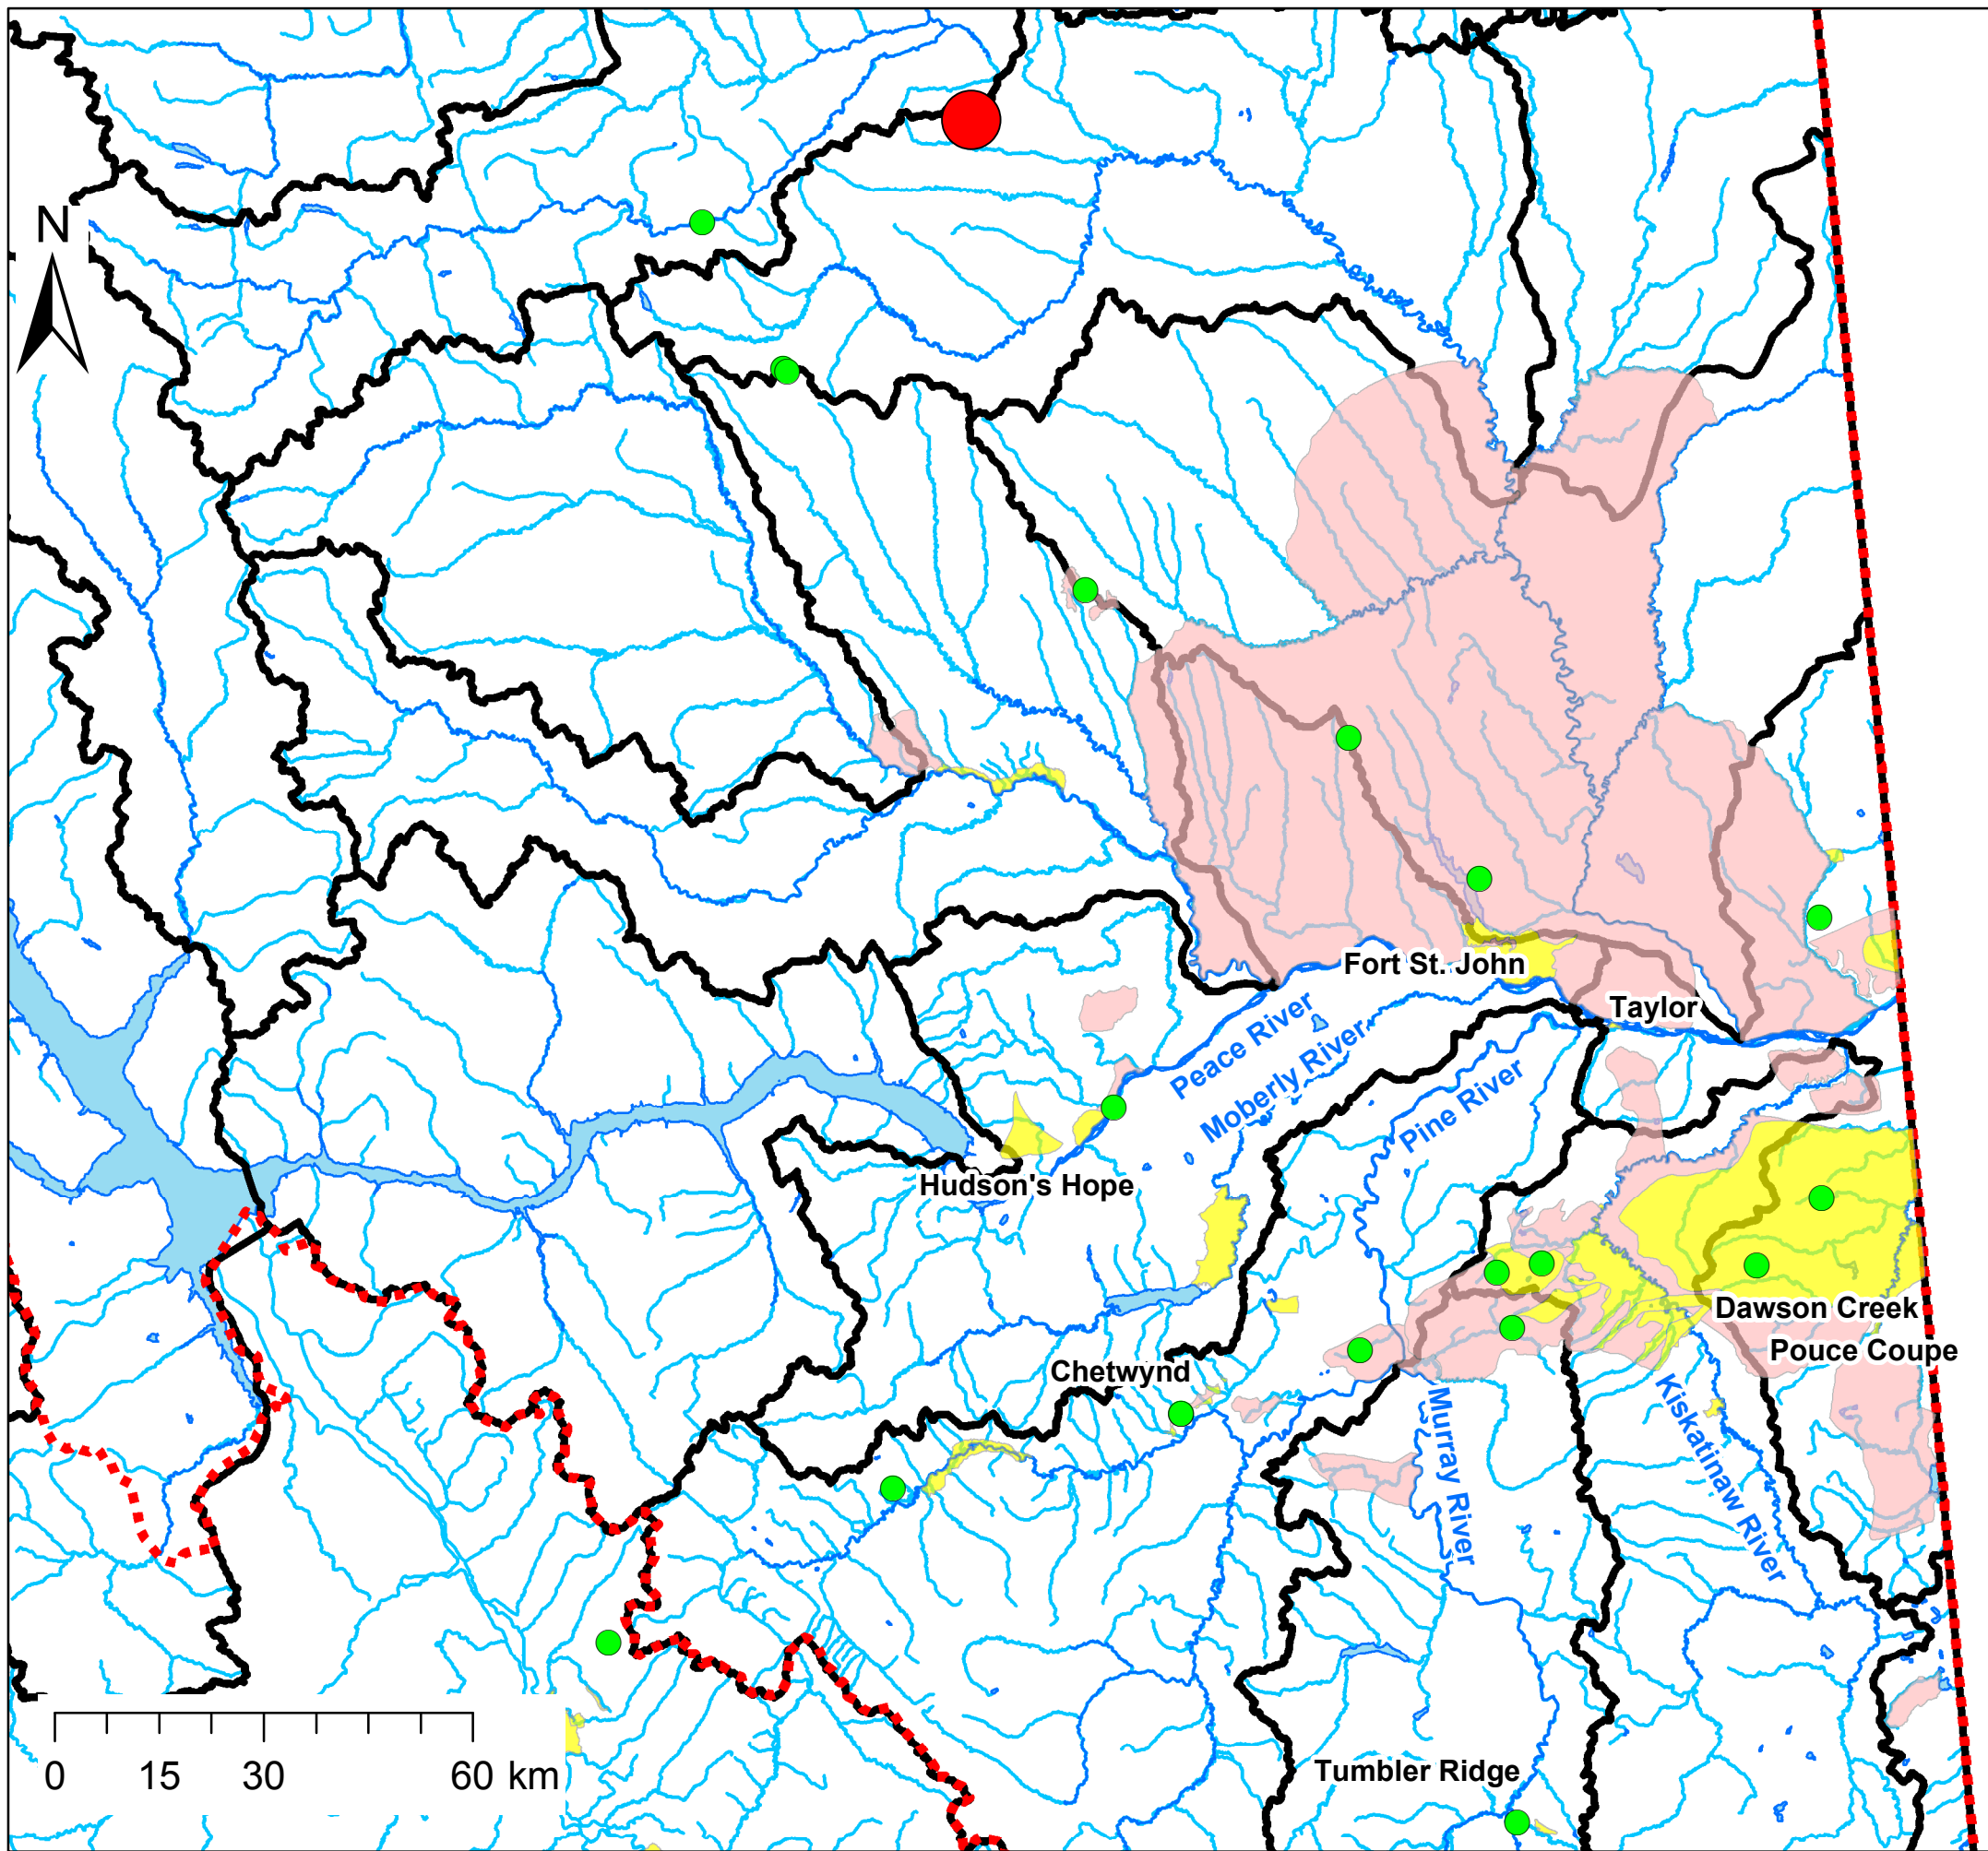**Exceedance analysis  
for fluoride (F)**



## Legend

-  PRRD boundary
-  Watershed boundary
-  Main Streams






## Mapped aquifers

### Aquifer type

-  Bedrock
-  Overburden


## GW Provincial drinking water (BCMoE)

### % of samples exceeding guideline




-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

**Exceedance analysis  
for nitrate (NO<sub>3</sub>)**

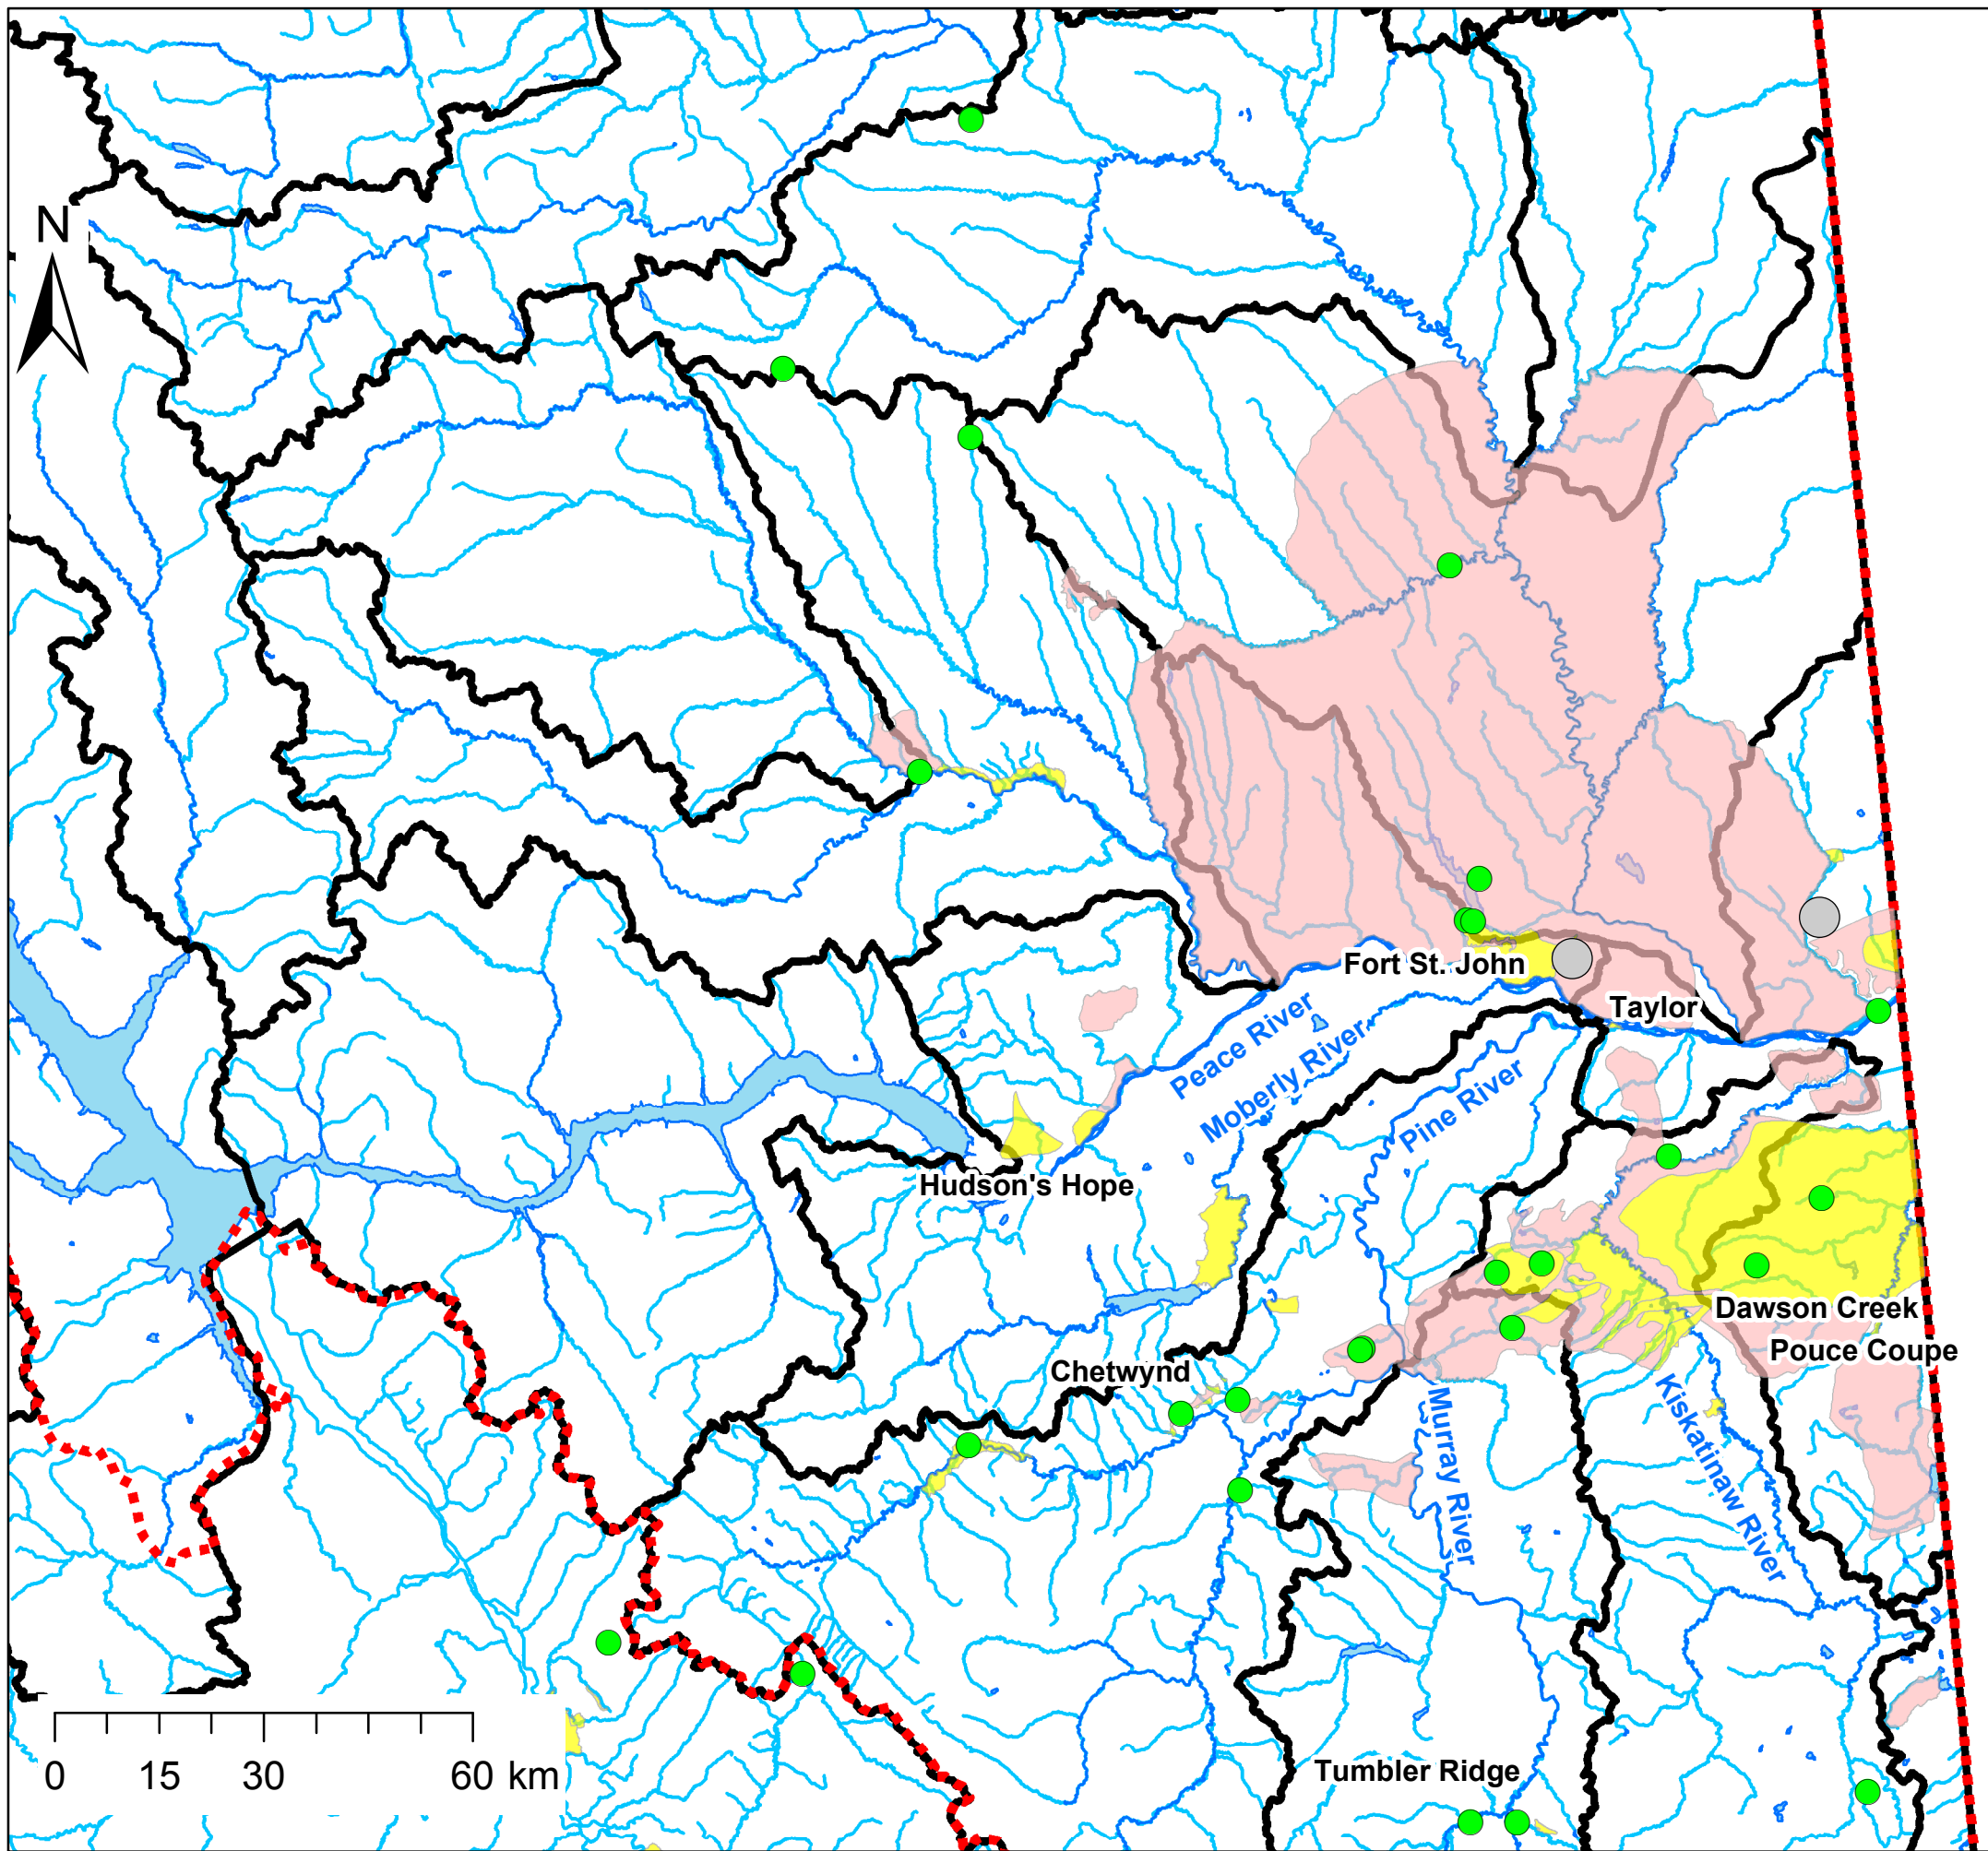



### Legend

-  PRRD boundary
-  Watershed boundary
-  Main Streams






### Mapped aquifers

#### Aquifer type


-  Bedrock
-  Overburden

### GW Provincial drinking water (BCMoE)




#### % of samples exceeding guideline

-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

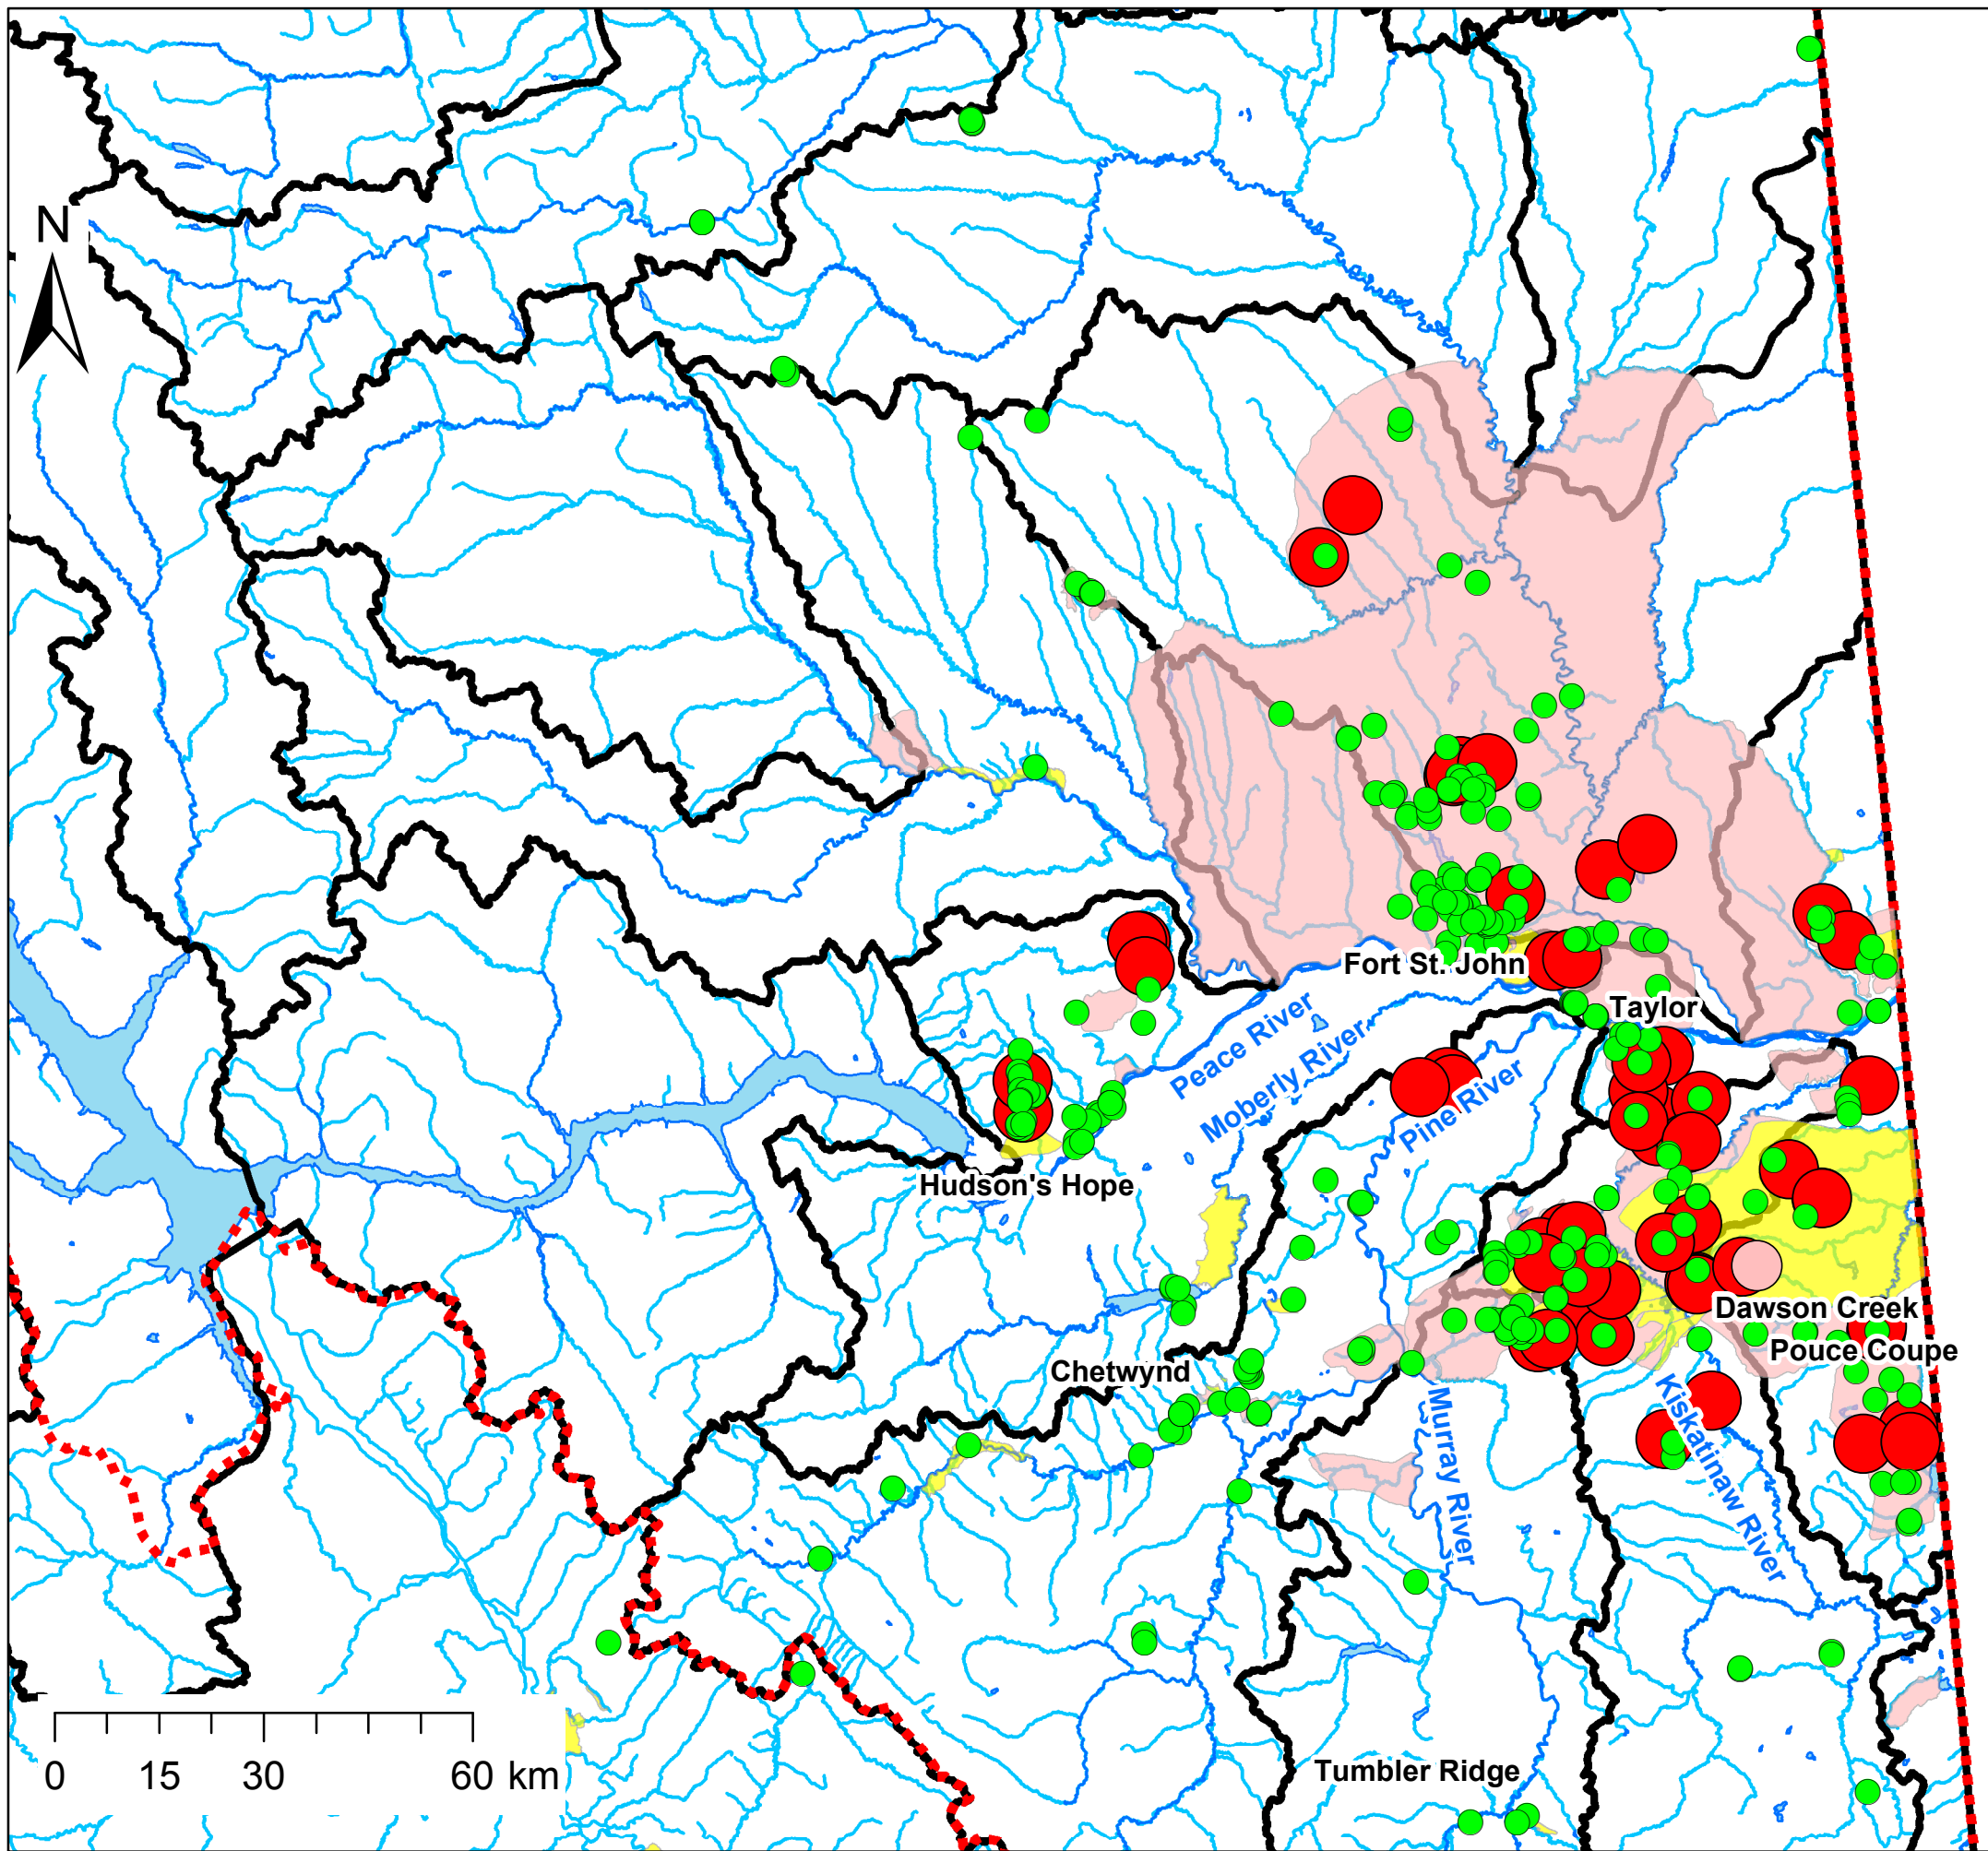**Exceedance analysis  
for nitrite (NO<sub>2</sub>)**



**Legend**

-  PRRD boundary
-  Watershed boundary
-  Main Streams






**Mapped aquifers**

**Aquifer type**

-  Bedrock
-  Overburden

**GW Provincial drinking water (BCMoE)**

**% of samples exceeding guideline**

-  No exceedance
-  =< 25% of samples exceed
-  25-50% of samples exceed
-  50-75% of samples exceed
-  75-100 of samples exceed

**Exceedance analysis  
for sulphate (SO<sub>4</sub>)**